


THIS DRAWING CONTAINS STRICKLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

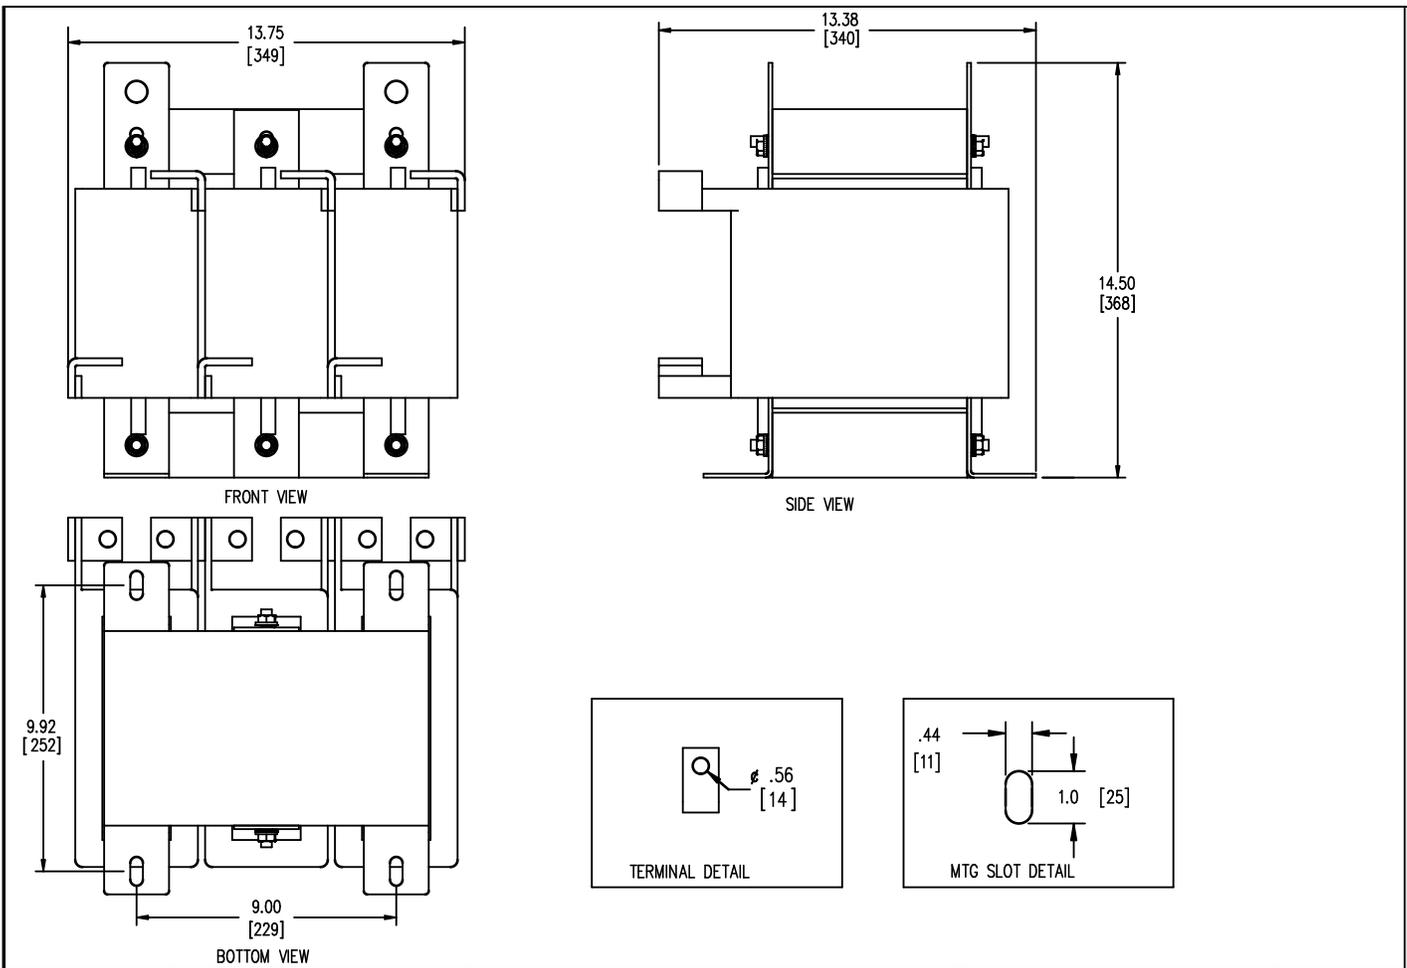

| | | | | |
|--|--|---|---|----------------|
| | <p>TOLERANCES MOUNTING CENTERS = +/- .06" MOUNTING HOLE SIZE = +/- .005"</p> | <p>THIS DRAWING CONTAINS PROPRIETARY INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS INC., AND IS NOT FOR GENERAL DISTRIBUTION</p> | <p>All Dimensions in Inches mm in Parenthesis</p> | <p>REACTOR</p> |
|--|--|---|---|----------------|

hammond
POWER SOLUTIONS

HPS CENTURION R
3PH DRY TYPE
REACTOR

P/N CRX0590AC

INDUCT. 0.038 MH 50/60 HZ 590 AMPS

0.6 KV CLASS WT: 133 lbs IP00

AMBIENT: 50° TEMP CLASS: 220 TYPE JR-2

USE WITH SUITABLY RATED LISTED (ZMVV) LUGS

WINDING TERMINAL TEMPERATURE: 75° C

MADE IN CANADA
 LR3902
 IND. CONT. EQ. E61431
 LISTED

f003782e

NOTES:

| | | | | | | | | | | | | | | | |
|--|----------|--|----------|----------|--------------------------------------|--|--|--|--|--|------|--------|-------|----------|--------|
| | | <p>TITLE: IRON CORE LINE REACTOR PROTOTYPE</p> | | | <p>SHEET 1 OF 1 EDBCRX0590AC</p> | | | | | | | | | | |
| <table border="1"> <tr> <td>NO.</td> <td>DATE</td> <td>BY</td> <td>REVISION</td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </table> | NO. | DATE | BY | REVISION | | | | | | <table border="1"> <tr> <td>DES:</td> <td>PBAKER</td> </tr> <tr> <td>DATE:</td> <td>14/07/04</td> </tr> <tr> <td>SCALE:</td> <td>NTS</td> </tr> </table> | DES: | PBAKER | DATE: | 14/07/04 | SCALE: |
| NO. | DATE | BY | REVISION | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | |
| DES: | PBAKER | | | | | | | | | | | | | | |
| DATE: | 14/07/04 | | | | | | | | | | | | | | |
| SCALE: | NTS | | | | | | | | | | | | | | |