hammond POWER SOLUTIONS

c UL US LISTED
E61431


GUELPH,ONT BARABOO,WI COMPTON,CA MONTERREY,MX

MADE IN CANADA

HPS Centurion S – 3 Phase SineWave Filter

RATING (HP)	300	CUST. REF.	
SYS. VOLTAGE	480	SERIAL NO.	
FREQ. (Hz)	90	PART NO.	CS1K0362F
CURRENT(AMP)	362	TYPE SJR–4	AN
		WDG MATERIAL	CU
TEMP. RISE °C	130	ENCL. TYPE	
TEMP. CLASS °C	220	WEIGHT lbs/kg	340/155

WARNING: CAPACITOR VOLTAGE ABOVE 50V MAY REMAIN FOR 180 SECONDS AFTER POWER IS DISCONNECTED.

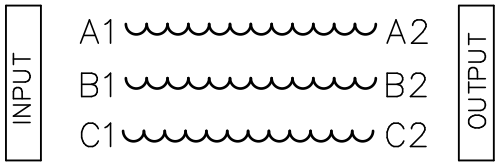

F0677EF

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.


hammond POWER SOLUTIONS

TITLE: LINE REACTOR
NAMEPLATE INFORMATION


NO.	DATE	BY	REVISION
1	24/02/28	PB	HCN: 80417

DES: PBAKER
DATE: 23/11/22
SCALE: NTS


EDBCS1K0362F

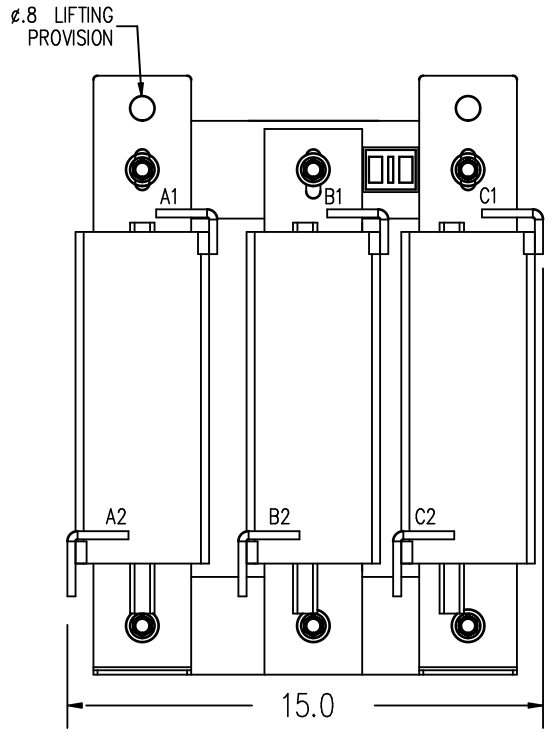


FRONT VIEW

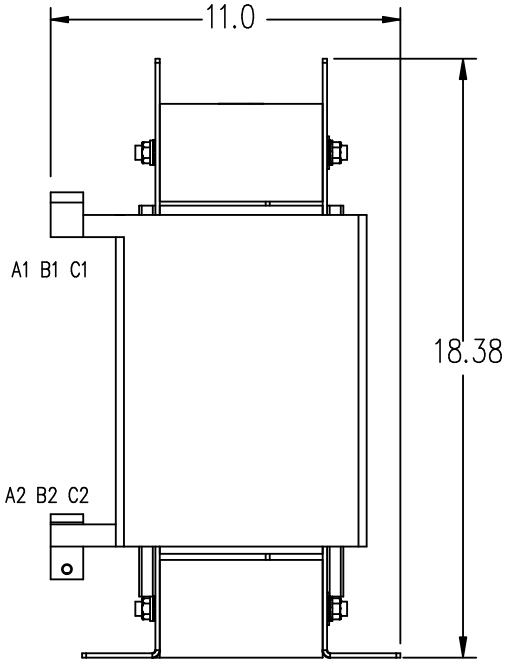

SIDE VIEW

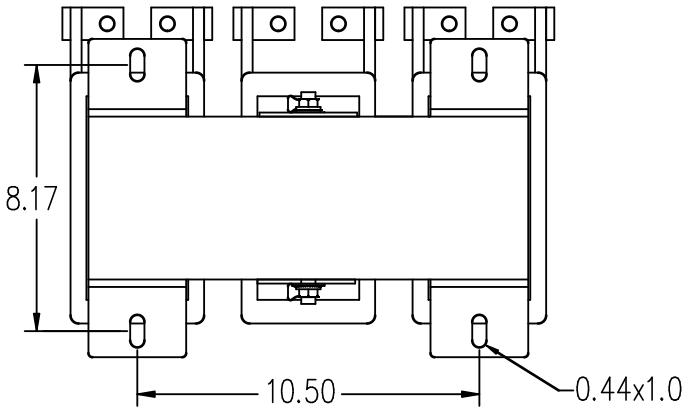

BOTTOM VIEW

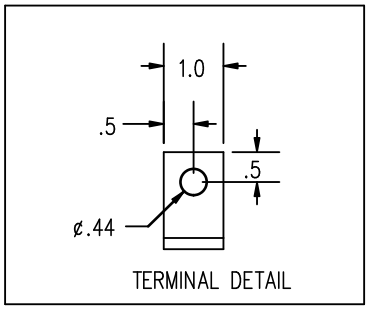

TERMINAL DETAIL

hammond POWER SOLUTIONS	TOLERANCES MOUNTING CENTERS = +/- .06" MOUNTING HOLE SIZE = +/- .005"	THIS DRAWING CONTAINS PROPRIETARY INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS INC., AND IS NOT FOR GENERAL DISTRIBUTION	All Dimensions in Inches mm in Parenthesis	FILTER

hammond POWER SOLUTIONS

TITLE: LINE REACTOR
FLOOR MOUNT DIMENSIONS

NO.	DATE	BY	REVISION
1	24/02/28	PB	HCN: 80417

DES: PBAKER
DATE: 23/11/22
SCALE: NTS


SHEET 2 OF 5


EDBCS1K0362F

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

1.2 httpd 2026/11/04 20:07

CPT06006

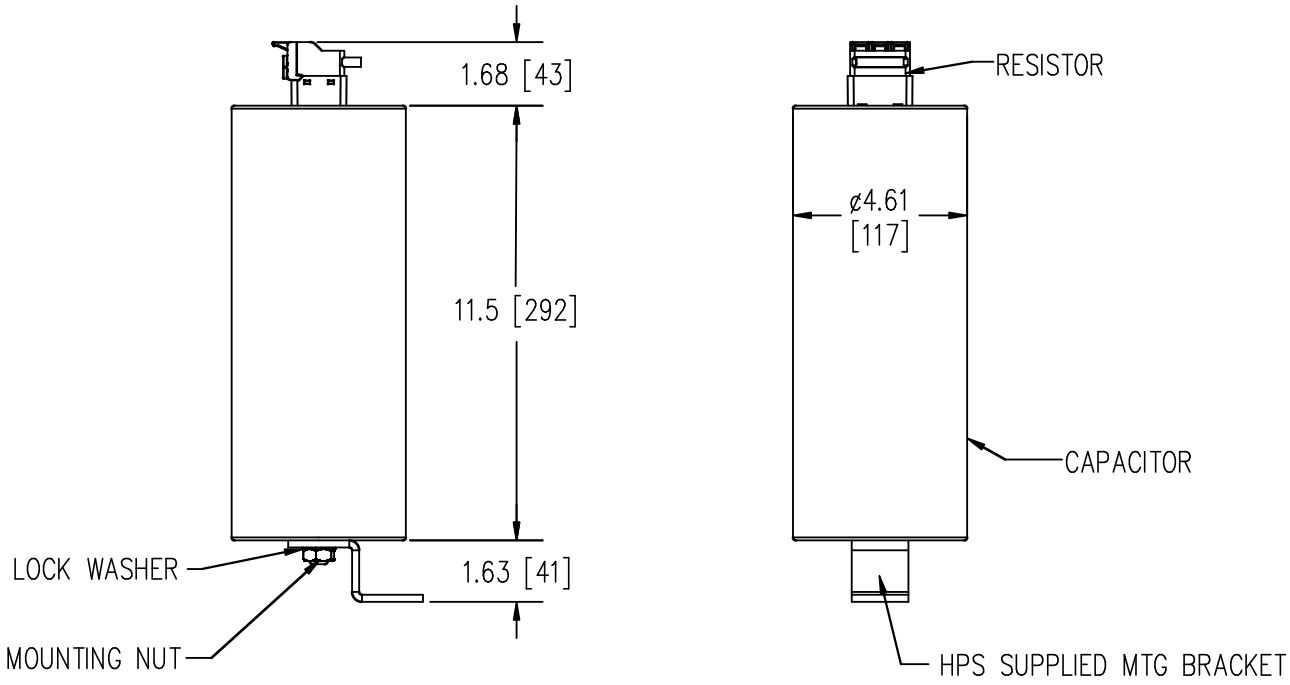

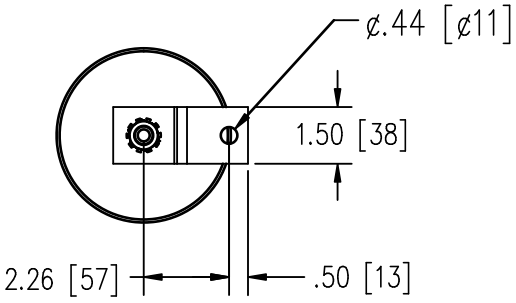

- ENSURE CAPACITOR BLEEDER RESISTOR IS INSTALLED IN CAPACITOR TERMINAL BLOCK.
- BLEEDER RESISTOR MAY BE SUPPLIED LOOSE WITH THE CAPACITOR.
- USE MIN # 8 AWG CONDUCTORS TO CONNECT TO FILTER.
- USE WIRE RATED FOR AT LEAST 90°C AND SIZED BASIS OF 75° AMPACITY.

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

hammond POWER SOLUTIONS

TITLE: LINE REACTOR
CAPACITOR DIMENSIONS
(1 CAPACITOR REQUIRED)

NO.	DATE	BY	REVISION
1	24/02/28	PB	HCN: 80417


DES: PBAKER
DATE: 23/11/22
SCALE: NTS


SHEET 3 OF 5

EDBCS1K0362F

1.2 httpd 2026/11/04 20:07

CPT06031

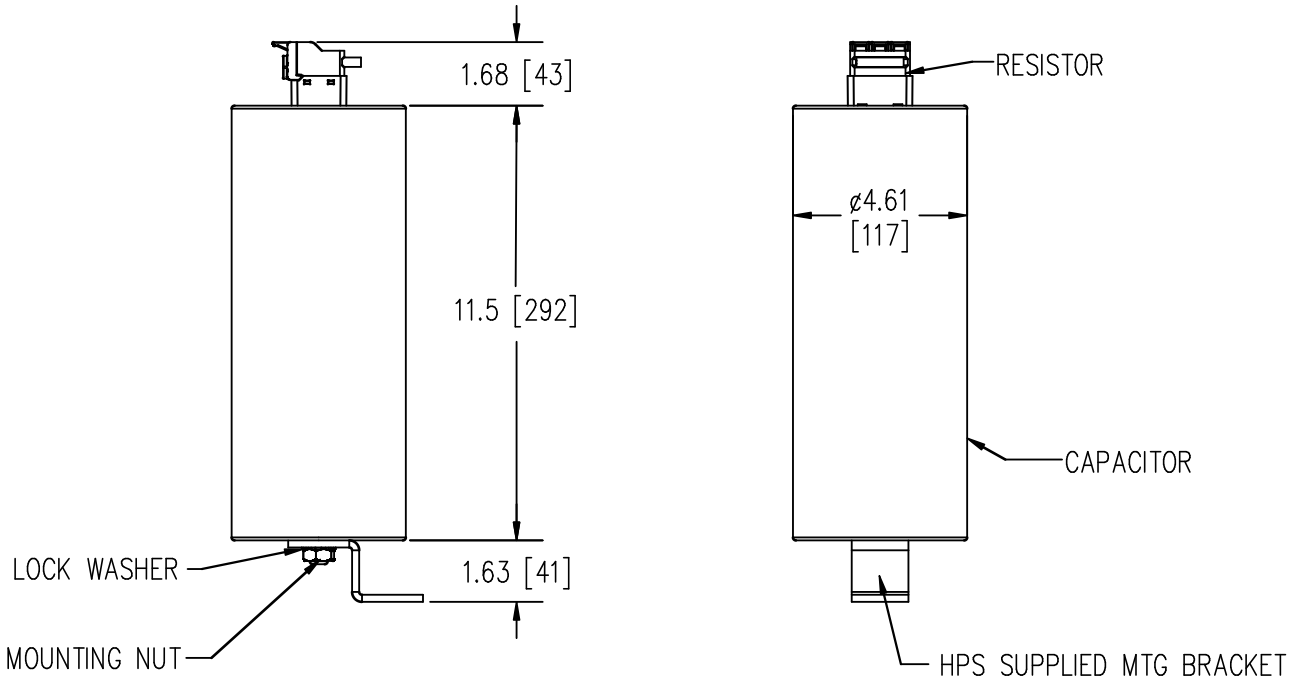

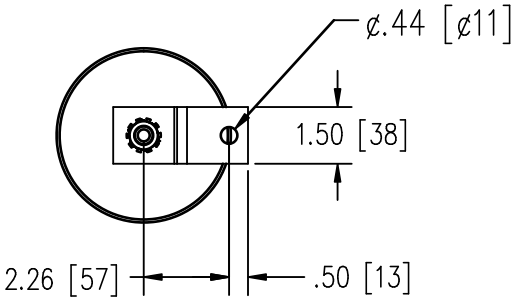

- ENSURE CAPACITOR BLEEDER RESISTOR IS INSTALLED IN CAPACITOR TERMINAL BLOCK.
- BLEEDER RESISTOR MAY BE SUPPLIED LOOSE WITH THE CAPACITOR.
- USE MIN # 8 AWG CONDUCTORS TO CONNECT TO FILTER.
- USE WIRE RATED FOR AT LEAST 90°C AND SIZED BASIS OF 75° AMPACITY.

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

hammond POWER SOLUTIONS


TITLE: LINE REACTOR
CAPACITOR DIMENSIONS
(2 CAPACITOR REQUIRED)

NO.	DATE	BY	REVISION
1	24/02/28	PB	HCN: 80417

DES: PBAKER
DATE: 23/11/22
SCALE: NTS

EDBCS1K0362F

1.2 httpd 2026/11/04 20:07

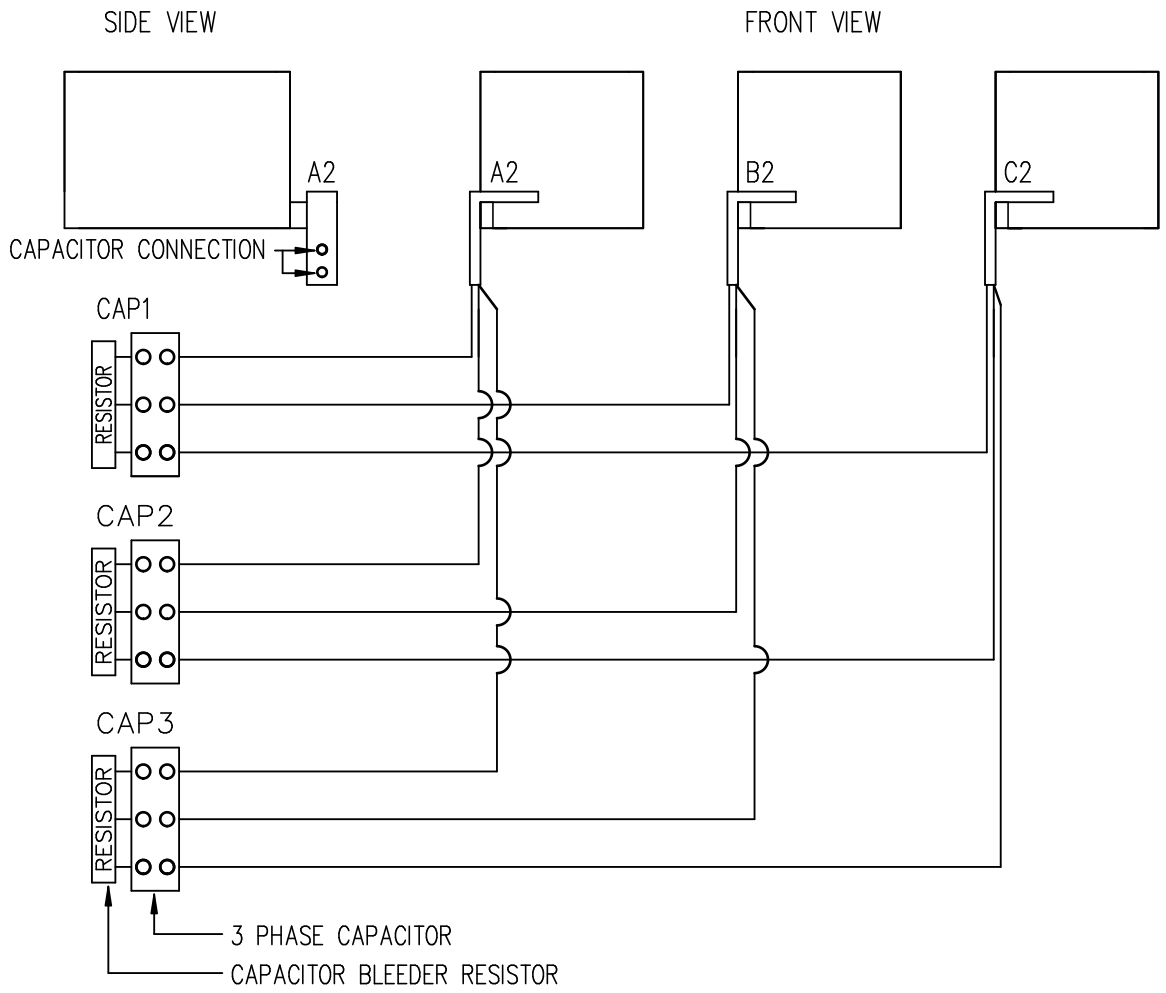

- ENSURE CAPACITOR BLEEDER RESISTOR IS INSTALLED IN CAPACITOR TERMINAL BLOCK. BLEEDER RESISTOR MAY BE SUPPLIED LOOSE WITH THE CAPACITOR.
- USE 1 WIRE ONLY FROM TERMINALS A2 B2 C2 TO EACH CAPACITOR. DONOT WIRE FROM CAPACITOR TO CAPACITOR.
- SEE CAPACITOR DRAWING FOR CORRECT CONDUCTOR SIZE.

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

hammond POWER SOLUTIONS

TITLE: LINE REACTOR
CAPACITOR WIRING

NO.	DATE	BY	REVISION
1	24/02/28	PB	HCN: 80417

DES: PBAKER
DATE: 23/11/22
SCALE: NTS

SHEET 5 OF 5

EDBCS1K0362F

1.2 httpd 2026/11/04 20:07