




THE IMPEDANCE SHOWN IS CALCULATED VALUE  
 TESTED IMPEDANCE WILL BE SHOWN ON TRANSFORMER NAMEPLATE.

<b>hammond</b> POWER SOLUTIONS				 LR 3902  DRY TYPE TRANSFORMER 7745 E112313 <b>LISTED</b>	
GUELPH, ONT. BARABOO,WI COMPTON, CA MONTERREY, MX					
THREE PHASE DRY TYPE DRIVE ISOLATION TRANSFORMER TRANSFORMATEUR TRIPHASE POUR VARIATEUR DE VITESSE DE MOTEURS					
HV/HT	460V			Cust. Ref. Réf. du client	
BIL	-			Serial No. No. de série	
TERM. BORNES	H1 H2 H3			Part No. No. de pièce	DM007JJCN
	VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE	kVA
	483 460 437	9.0 9.4 9.9	105 100 95	1-2 2-3 3-4	7.5
					TYPE
					K
					Cooling Refroidissement
					ANN
					Temp. Rise Echauffement
					130 °C
					Temp. Class Classe de Temp.
					200 °C
					Frequency Fréquence
					60 Hz
					Impédance % @ 150 °C
					4.2
LV/BT	460Y/266V			Encl. Type Type de boîtier	3R
BIL	-			Wt Poids	lbs/kg 159/73
TERM. BORNES	X0 X1 X2 X3			Winding Enroulement	CU
				SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 1 INCHES	

d003102b

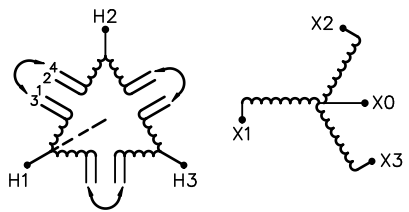

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

3.0 httpd 2026/06/03 16:00




TITLE: 3PH DRIVE TRANSFORMER  
 NAMEPLATE INFORMATION

3	22/09/12	GC	CHANGED NPL VER:	DES: GRID1
2	21/07/16	PP	EDB UPDATE	DATE: 04/05/26
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 2

EDBDM007JJCN

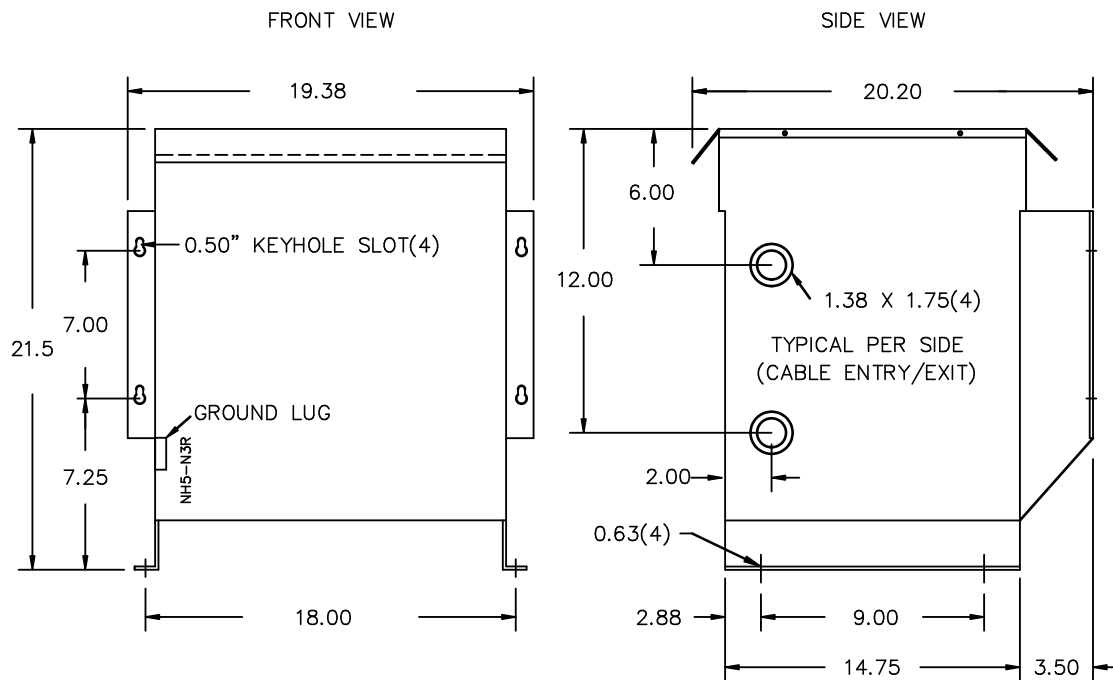

All Dimensions in inches

ENCLOSURE COLOR : ANSI-61 GREY PAINT OUTDOOR.

CUSTOMER NOTES:

- HV TERMINATED AT BOTTOM FRONT
- LV TERMINATED AT BOTTOM FRONT
- C/W 1-"NC"- THERMOSTAT PER COIL CONNECTED TO T.B.



TITLE: 3PH DRIVE TRANSFORMER

3	22/09/12	GC	CHANGED NPL VER:	DES: GRID1
2	21/07/16	PP	EDB UPDATE	DATE: 04/05/26
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 2

EDBDM007JJCIN