



® LR 3902

UL DRY TYPE TRANSFORMER 774J5 E112313

LISTED

GUELPH, ONT. BARABOO, WI COMPTON, CA MONTERREY, MX

THREE PHASE DRY TYPE DRIVE ISOLATION TRANSFORMER
TRANSFORMATEUR TRIPHASE POUR VARIATEUR DE VITESSE DE MOTEURS

HV/HT	575V				Cust. Ref. Réf. du client	
BIL	-				Serial No. No. de série	
TERM. BORNES	H1 H2 H3				Part No. No. de pièce	DM007NNCN
	VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE	kVA	7.5
	604	7.2	105	1	TYPE	K
	575	7.5	100	2	Cooling Refroidissement	ANN
	546	7.9	95	3	Temp. Rise Echauffement	130 °C
					Temp. Class Classe de Temp.	200 °C
					Frequency Fréquence	60 Hz
					Impédance % @ 150 °C	4
LV/BT	575Y/332V				Encl. Type Type de boîtier	3R
BIL	-				Wt Poids lbs/kg	165/75
TERM. BORNES	X0 X1 X2 X3				Winding Enroulement	CU



SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 1 INCHES

d003102b



TITLE: 3PH DRIVE TRANSFORMER
NAMEPLATE INFORMATION

4	21/07/16	PP	EDB UPDATE	DES: GRID1
3	15/02/24	ME	HCN: 47179	DATE: 04/05/03
NO.	DATE	BY	REVISION	SCALE: NTS


SHEET 1 OF 2

EDBDM007NNCN

FRONT VIEW



SIDE VIEW

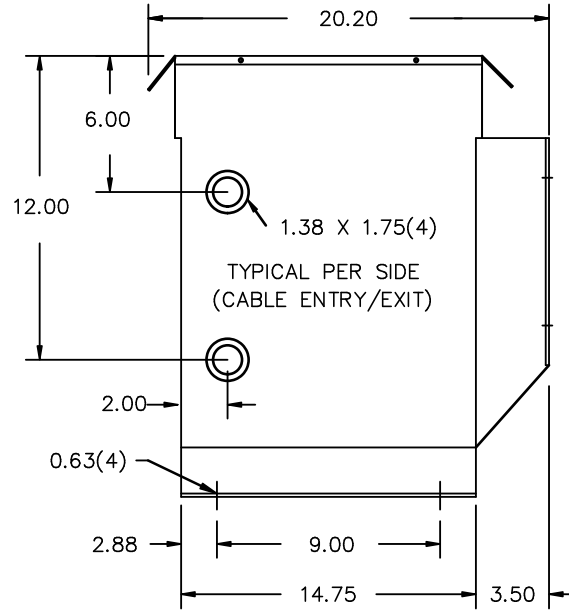

All Dimensions in inches

ENCLOSURE COLOR : ANSI-61 GREY PAINT OUTDOOR.

H.V.1. TERMINAL DETAIL

L.V.1. TERMINAL DETAIL

SUITABLE FOR #14-4 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

SUITABLE FOR #14-4 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV1 TERMINATED AT BOTTOM FRONT
- LV1 TERMINATED AT BOTTOM FRONT
- C/W 1-"NC"- THERMOSTAT PER COIL CONNECTED TO T.B.



TITLE: 3PH DRIVE TRANSFORMER

4	21/07/16	PP	EDB UPDATE	DES: GRID1
3	15/02/24	ME	HCN: 47179	DATE: 04/05/03
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 2

EDBDM007NNCN