




THE IMPEDANCE SHOWN IS CALCULATED VALUE.
TESTED IMPEDANCE WILL BE SHOWN ON TRANSFORMER NAMEPLATE.

					
GUELPH, ONT. BARABOO, WI COMPTON, CA MONTERREY, MX					
THREE PHASE DRY TYPE DRIVE ISOLATION TRANSFORMER TRANSFORMATEUR TRIPHASE POUR VARIATEUR DE VITESSE DE MOTEURS					
HV/HT	575V			Cust. Ref.	
BIL	-			Serial No.	
TERM. BORNES	H1 H2 H3			Part No.	DMO11NJ
	VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE	kVA
	604	10.5	105	1-2	11
	575	11.0	100	2-3	TYPE
	546	11.6	95	3-4	K
				Cooling Refroidissement	ANN
				Temp. Rise Echauffement	150 °C
				Temp. Class Classe de Temp.	220 °C
				Frequency Fréquence	60 Hz
				Impédance % @ 170 °C	5.1
LV/BT	460Y/266V			Encl. Type Type de boîtier	3R
BIL	-			Wt lbs/kg Poids	165/75
TERM. BORNES	X0 X1 X2 X3			Winding Enroulement	AL
				SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 1 INCHES	

d003102b

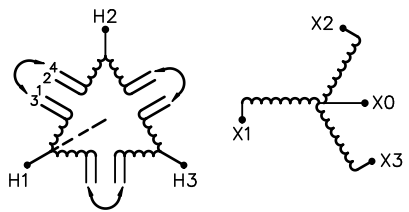

TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

6	21/07/13	PP	EDB UPDATE	DES: VGAGAC
5	21/03/18	AA	LUGS UPDATED	DATE: 00/06/02
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 2

EDBDM011NJ

6.0 httpd 2026/05/18 06:47 THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW



SIDE VIEW



All Dimensions in inches

ENCLOSURE COLOR : ANSI-61 GREY PAINT OUTDOOR.

HV TERMINAL DETAIL

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- C/W 1-"NC"-THERMOSTAT PER COIL CONNECTED TO T.B.



TITLE: 3PH DISTRIBUTION TRANSFORMER

6	21/07/13	PP	EDB UPDATE	DES: VGAGAC
5	21/03/18	AA	LUGS UPDATED	DATE: 00/06/02
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 2

EDBDM011NJ