



® LR 3902


UL DRY TYPE TRANSFORMER 774J5 E112313

LISTED

GUELPH, ONT. BARABOO, WI COMPTON, CA MONTERREY, MX

THREE PHASE DRY TYPE DRIVE ISOLATION TRANSFORMER
TRANSFORMATEUR TRIPHASE POUR VARIATEUR DE VITESSE DE MOTEURS

HV/HT	480V				Cust. Ref. Réf. du client	
BIL	-				Serial No. No. de série	
TERM. BORNES	H1 H2 H3				Part No. No. de pièce	DM275KK
	VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE	kVA	275
	504	315	105	1	TYPE	K
	492	323	102.5	2	Cooling Refroidissement	ANN
	480	331	100	3	Temp. Rise Echauffement	150 °C
	468	339	97.5	4	Temp. Class Classe de Temp.	220 °C
	456	348	95	5	Frequency Fréquence	60 Hz
					Impédance % @ 170 °C	5.4
LV/BT	480Y/277V				Encl. Type Type de boîtier	3R
BIL	-				Wt Poids	1450
TERM. BORNES	X0 X1 X2 X3				Winding Enroulement	AL

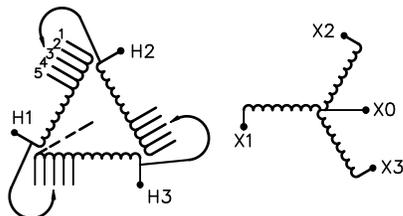

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 5 INCHES

4003102b




TITLE: 3PH DRIVE TRANSFORMER
NAMEPLATE INFORMATION

2	21/07/13	PP	EDB UPDATE	DES: RBHATIA
1	15/03/26	ME	HCN: 44319	DATE: 14/03/11
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 2


EDBDM275KK

FRONT VIEW

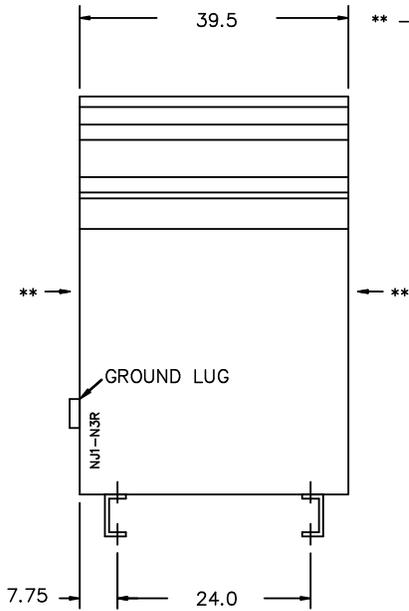

** - Recommended cable entry locations only
cutouts & gland plates not provided.


SIDE VIEW

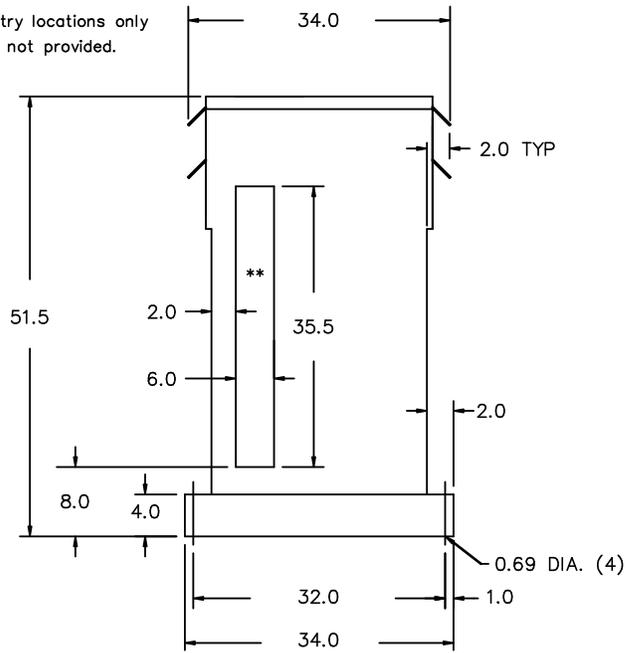


All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY - OUTDOOR

HV TERMINAL DETAIL

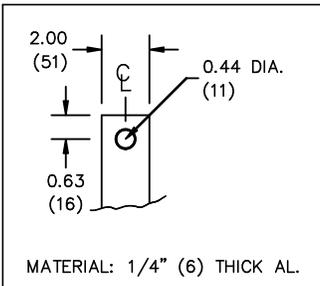

LV TERMINAL DETAIL

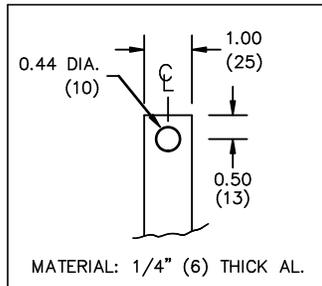

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- C/W 1-"NC"- THERMOSTAT PER COIL CONNECTED TO T.B.



TITLE: 3PH DRIVE TRANSFORMER

2	21/07/13	PP	EDB UPDATE	DES: RBHATIA
1	15/03/26	ME	HCN: 44319	DATE: 14/03/11
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 2

EDBDM275KK