hammond POWER SOLUTIONS

Distribution Transformer
Transformateur de Distribution

Hyderabad, IN | Guelph, ONT Compton, CA | Baraboo, WI Monterrey, MX

Part No. MG3A0030SBSAGC0

LR 3902

DISTRIBUTION TRANSFORMER
56Y1
E147879
LISTED


8 03423 13389 4

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC.® 3VJ6

Cust. Ref. / Ref. du Client		Serial No. / No. de Serie	
Phase	3	HV/HT	4160V 4.2A
Type	K	BIL	30 kV
Cooling / Refroidissement	ANN	Term / Bornes	H1 H2 H3
kVA	30	LV/BT	208Y/120V 83.3A
Temp. Rise / Echauffement	130 °C	BIL	10 kV
Temp Class / Classe Temp	200°C	Term / Bornes	X0 X1 X2 X3
Winding / Enroulement	CU/AL	Energy Regulations	DOE 10 CFR PART 431:2016
Frequency / Frequence Hz	60	Reglements de Energetique	CEE ACT SOR/2018-201
Impedance % @ 150 °C	4		
Encl. Type/Category / Type ou categorie de boîtier	3R C		
Weight / Poids lbs	425		

VOLTS	CURRENT / COURANT	% RATED VOLTAGE / % TENSION NOMINALE	CONNECTION EACH PHASE / CONNEXION PAR PHASE
4368	4.0	105	1-2
4264	4.1	102.5	2-3
4160	4.2	100	3-4
4056	4.3	97.5	4-5
3952	4.4	95	5-6

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

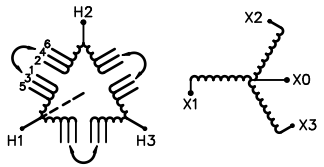

SEISMIC QUALIFICATIONS:
OSP-0136/IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=1 Ip=1.5

d0005806b

TITLE: 3PH DISTRIBUTION TRANSFORMER. NAMEPLATE INFORMATION

NO.	DATE	BY	REVISION
4	21/07/16	PP	EDB UPDATE
3	21/03/03	DC	UPDATED TOTAL WEIGHT(HON:74187)

SCALE: NTS | DATE: 15/11/30 | DES.: ASETH


SHEET 1 OF 3

EDB MG3A0030SBSAGC0


4.0 httpd 2026/11/05 06:25

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW

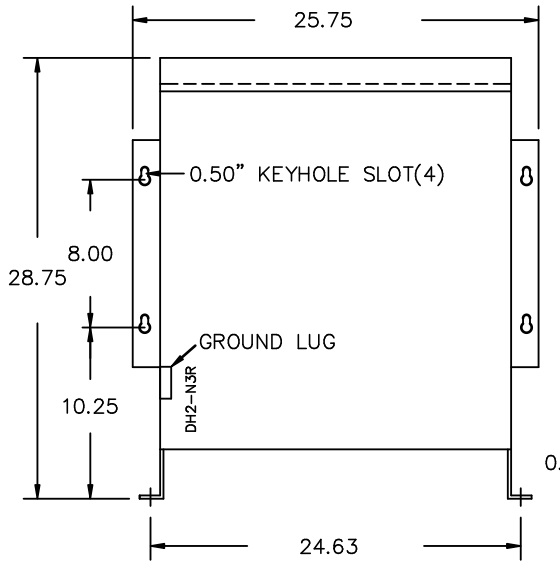

SIDE VIEW

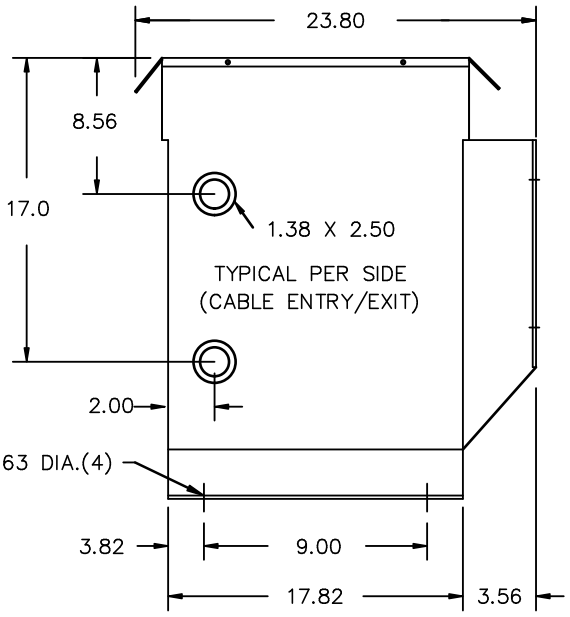

All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14–2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #2/0–14 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:
- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

4.0 httpd 2026/11/05 06:25

hammond POWER SOLUTIONS


TITLE: 3PH DISTRIBUTION TRANSFORMER.

NO.	DATE	BY	REVISION
4	21/07/16	PP	EDB UPDATE
3	21/03/03	DC	UPDATED TOTAL WEIGHT(HCN: 74187)

DES: ASETH
DATE: 15/11/30
SCALE: NTS

EDB MG3A0030SBSAGCO

ENCLOSURE BOTTOM VIEW

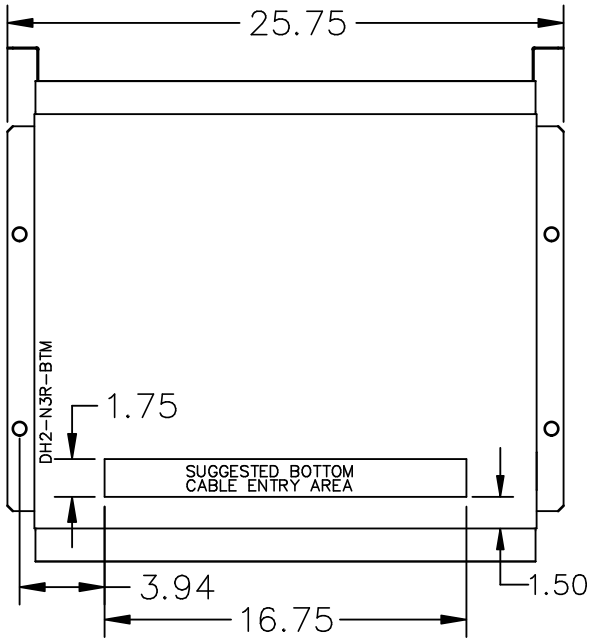

NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER.
ENCLOSURE BOTTOM VIEW

NO.	DATE	BY	REVISION	
4	21/07/16	PP	EDB UPDATE	DES: ASETH
3	21/03/03	DC	UPDATED TOTAL WEIGHT(HCN:74187)	DATE: 15/11/30
				SCALE: NTS

SHEET 3 OF 3

EDB MG3A003SBSAGG0

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

4.0 httpd 2026/11/05 06:25