hammond POWER SOLUTIONS

Distribution Transformer
Transformateur de Distribution

Hyderabad, IN
Guelph, ONT
Compton, CA
Baraboo, WI
Monterrey, MX

Part No. MG3A0030SPSAGC0

LR 3902

DISTRIBUTION TRANSFORMER
56Y1
E147879
LISTED


8 03423 13299 6


ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC. 3VJ6

Cust. Ref. / Ref. du Client		Serial No. / No. de Serie	
Phase	3	HV/HT	4160V 4.2A
Type	K	BIL	30 kV
Cooling / Refroidissement	ANN	Term / Bornes	H1 H2 H3
kVA	30	LV/BT	600Y/346V 28.9A
Temp. Rise / Echauffement	130 °C	BIL	10 kV
Temp Class / Classe Temp	200°C	Term / Bornes	X0 X1 X2 X3
Winding / Enroulement	CU/AL	Energy Regulations	DOE 10 CFR PART 431:2016
Frequency / Frequence Hz	60	Reglements de Energetique	CEE ACT SOR/2018-201
Impedance % @ 150 °C	3.2		
Encl. Type/Category / Type ou categorie de boîtier	3R C		
Weight / Poids lbs	460		

VOLTS	CURRENT / COURANT	% RATED VOLTAGE / % TENSION NOMINALE	CONNECTION EACH PHASE / CONNEXION PAR PHASE
4368	4.0	105	1-2
4264	4.1	102.5	2-3
4160	4.2	100	3-4
4056	4.3	97.5	4-5
3952	4.4	95	5-6

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES
ESPACEMENTS ENTRE LES PANNEAUX DE BOÎTIER VENTILÉ ET LES MURS ADJACENT DOIVENT ÊTRE UN MINIMUM DE 3 POUNCES





SEISMIC QUALIFICATIONS, AS FLOOR MOUNT ONLY
QUALIFICATIONS SISIQUES, COMME MONTAGE AU SOL SEULEMENT
IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=0 Ip=1.5

d0005980b

- IMPEDANCE SHOWN IS CALCULATED VALUE

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER. NAMEPLATE INFORMATION

NO.	DATE	BY	REVISION
4	21/07/16	PP	EDB UPDATE
3	20/03/17	PP	SEISMIC UPDATE


SCALE: NTS
DATE: 15/11/30
DES.: ASETH

SHEET 1 OF 3


EDB MG3A0030SPSAGC0

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW

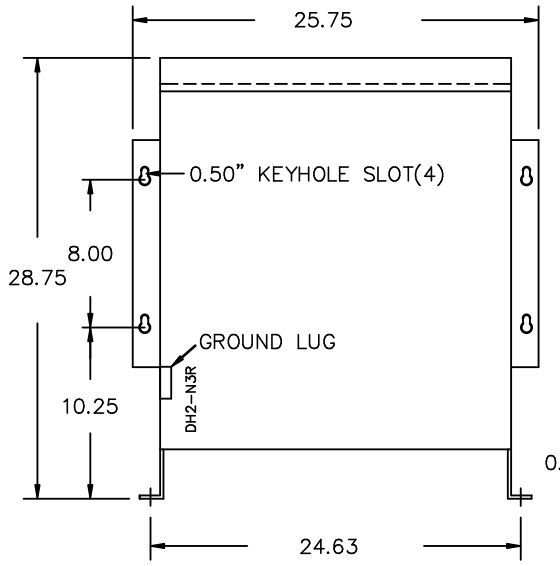

SIDE VIEW

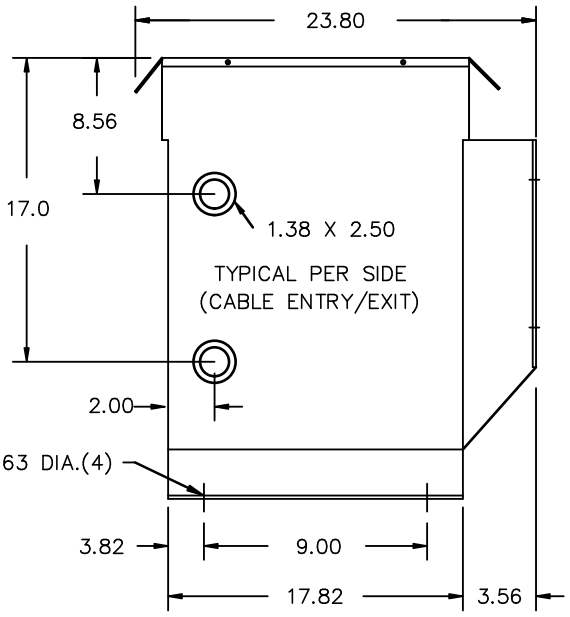

All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14–2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14–2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:
- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

4.0 httpd 2026/11/05 05:59

hammond POWER SOLUTIONS


TITLE: 3PH DISTRIBUTION TRANSFORMER.
MECHANICAL INFORMATION

NO.	DATE	BY	REVISION	
4	21/07/16	PP	EDB UPDATE	DES: ASETH
3	20/03/17	PP	SEISMIC UPDATE	DATE: 15/11/30
				SCALE: NTS

SHEET 2 OF 3

EDBMG3A0030PSAGGO

ENCLOSURE BOTTOM VIEW

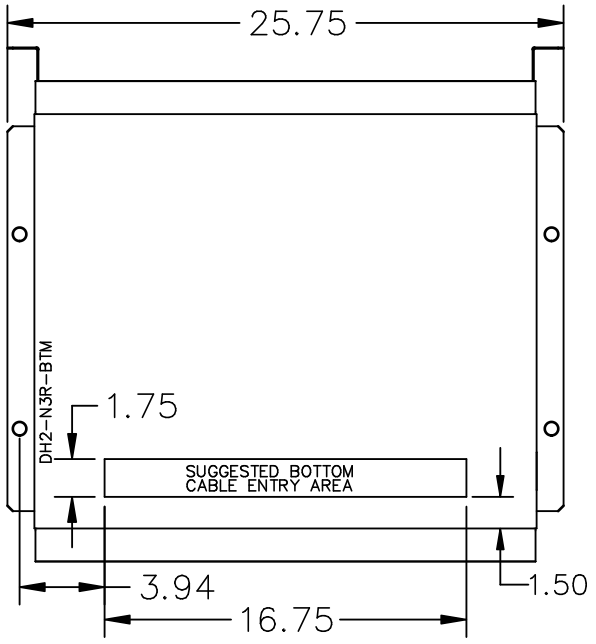

NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER.
ENCLOSURE BOTTOM VIEW

NO.	DATE	BY	REVISION	
4	21/07/16	PP	EDB UPDATE	DES: ASETH
3	20/03/17	PP	SEISMIC UPDATE	DATE: 15/11/30
				SCALE: NTS

SHEET 3 OF 3

EDBMG3A0030PSAGG0

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

4.0 httpd 2026/11/05 05:59