



TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION


3	23/01/26	DC	UPDATED NRCAN VERSION	DES: MABDELAT
2	21/07/16	PP	EDB UPDATE	DATE: 17/06/28
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 3

EDBMG3A0075SBSGCCO

3.0 httpd 2026/04/07 00:08


THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.



hammond
POWER SOLUTIONS

Distribution Transformer
Transformateur de Distribution

LR 3902
DISTRIBUTION TRANSFORMER
E147879




LISTED

Guelph, ONT Baraboo, WI
Compton, CA Monterrey, MX

Hyderabad, IN Part No. MG3A0075SBSGCCO

Cust. Ref. Ref. du Client	Serial No. No. de Serie		
Phase	HV/HT	4160V	10.4A
Type	BIL	30 kV	
Cooling Refroidissement	Term Bornes	H1 H2 H3	
kVA	LV/BT	208Y/120V	208A
Temp. Rise Echauffement	BIL	10 kV	
Temp Class	Term Bornes	X0 X1 X2 X3	
Winding Enroulement	Energy Regulations	DOE 10 CFR PART 431:2016	
Frequency	Reglements Energetique	CEE ACT SOR/2018-201	
Impedance % @ 150°C			
End. Type/Category Type ou categorie de boitier		3R	C
Weight Poids		735	334


VOLTS	CURRENT COURANT	% RATED VOLTAGE % NOMINALE	CONNECTION FOR CONNECTION PAR PHASE
4368	9.9	105	1-2
4264	10.2	102.5	2-3
4160	10.4	100	3-4
4056	10.7	97.5	4-5
3952	11.0	95	5-6

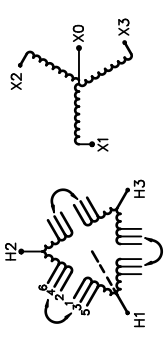

SEISMIC QUALIFICATIONS:
AS FLOOR MOUNT ONLY
IBC 2018/ASCE 7-16
SDS<=2.0g Z/n=1 Ip=1.5

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

d000590hb

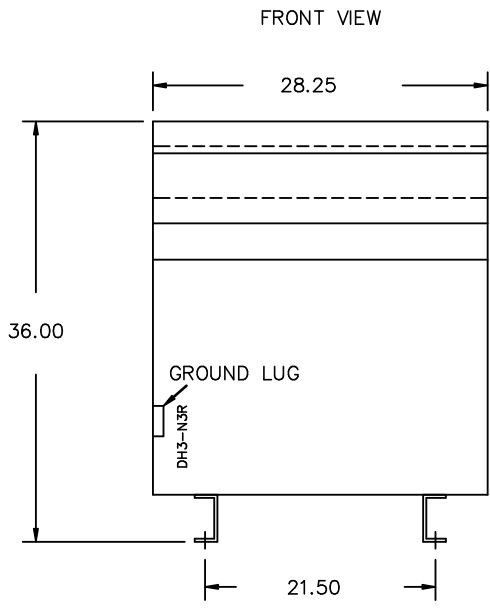

All Dimensions in inches



ENCLOSURE COLOR :ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #2/0-14 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR 600MCM-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT



TITLE: 3PH DISTRIBUTION TRANSFORMER

3	23/01/26	DC	UPDATED NRCAN VERSION	DES: MABELLAT
2	21/07/16	PP	EDB UPDATE	DATE: 17/06/28
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBMC3A0075SBSGCCO

3.0 httpd 2026/04/07 00:08

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

ENCLOSURE BOTTOM VIEW



NOTE:
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER
 ENCLOSURE BOTTOM VIEW

3	23/01/26	DC	UPDATED NRCAN VERSION	DES: MABELLAT
2	21/07/16	PP	EDB UPDATE	DATE: 17/06/28
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDBMC3A0075SBSGCCO