hammond POWER SOLUTIONS

Energy Efficient
General Purpose Distribution Transformer
Transformateur de Distribution
à usage général économe en énergie

Hyderabad, IN | Guelph, ONT | Compton, CA | Baraboo, WI | Monterrey, MX

Part No. SG3A0300PB

LR 3902

DRY TYPE TRANSFORMER 77U5 E112313 LISTED


ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC.® 3VJ6

8 03423 12553 0

| | | | |
|---|---|---|---|
| Cust. Ref. / Ref. du Client | | Serial No. / No. de Serie | |
| Phase | 3 | HV/HT | 600V 289A |
| Type | K | BIL | 10 kV |
| Cooling / Refroidissement | ANN | Term / Bornes | H1 H2 H3 |
| kVA | 300 | LV/BT | 208Y/120V 833A |
| Temp. Rise / Echauffement | 150 °C | BIL | 10 kV |
| Temp Class / Classe Temp | 220 °C | Term / Bornes | X0 X1 X2 X3 |
| Winding / Enroulement | AL | Energy Regulations | DOE 10 CFR PART 431:2016 |
| Frequency / Frequence Hz | 60 | Reglements de Energetique | CEE ACT SOR/2018-201 |
| Impedance % @ 170 °C | 4.8 | | |
| Encl Type / Type De Coffrage | 3R | | |
| Weight / Poids lbs/kg | 2010/912 | | |

| VOLTS | CURRENT / COURANT | % RATED VOLTAGE / % TENSION NOMINALE | CONNECTION EACH PHASE / CONNEXION PAR PHASE |
|---|---|---|---|
| 630 | 275 | 105 | 1 |
| 615 | 282 | 102.5 | 2 |
| 600 | 289 | 100 | 3 |
| 585 | 296 | 97.5 | 4 |
| 570 | 304 | 95 | 5 |
| 555 | 312 | 92.5 | 6 |
| 540 | 321 | 90 | 7 |

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 5 INCHES

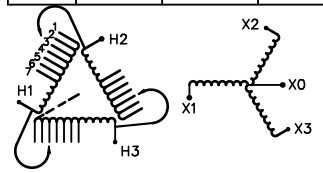


SEISMIC QUALIFICATIONS:
AS FLOOR MOUNT ONLY
IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=0 Ip=1.5

d000186hb

TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

| NO. | DATE | BY | REVISION |
|---|---|---|---|
| 3 | 21/07/16 | PP | EDB UPDATE |
| 2 | 20/03/17 | PP | SEISMIC UPDATE |

SCALE: NTS | DATE: 15/11/09 | DES: JWEN


SHEET 1 OF 3

EDBSG3A0300PB




THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW

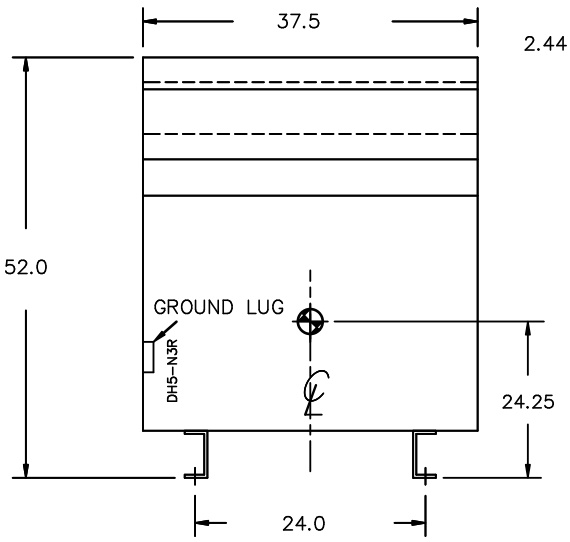



SIDE VIEW

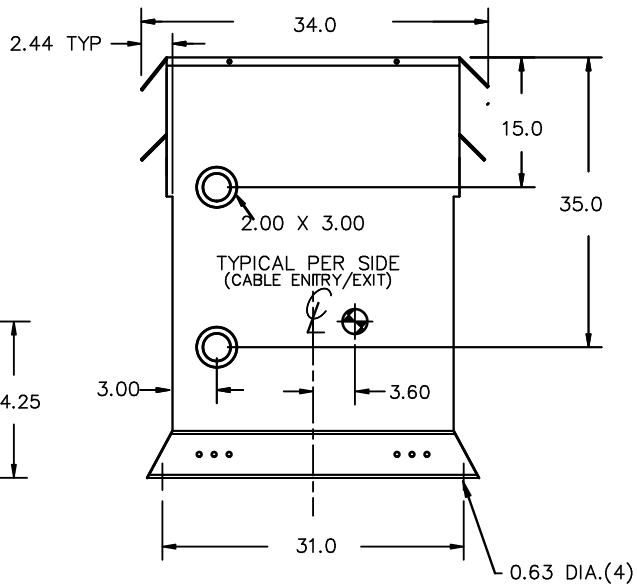



All Dimensions in inches

ENCLOSURE COLOR :ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

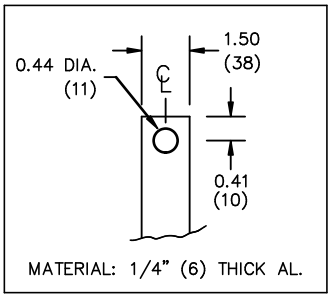


LV TERMINAL DETAIL

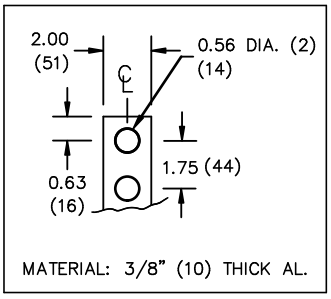


CUSTOMER NOTES:
- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

3.1 httpd 2026/11/05 01:52

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER


| NO. | DATE | BY | REVISION |
|---|---|---|---|
| 3 | 21/07/16 | PP | EDB UPDATE |
| 2 | 20/03/17 | PP | SEISMIC UPDATE |

DES: JWEN
DATE: 15/11/09
SCALE: NTS

SHEET 2 OF 3

EDBSG3A0300PB

ENCLOSURE BOTTOM VIEW

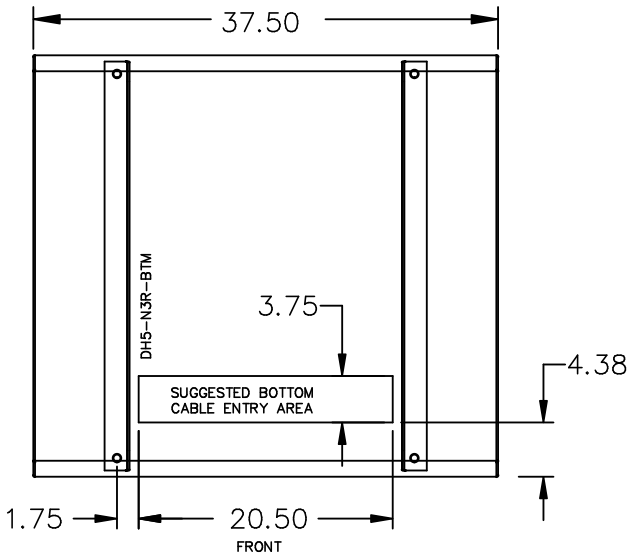


NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

3.1 httpd 2026/11/05 01:52

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER ENCLOSURE BOTTOM VIEW

| NO. | DATE | BY | REVISION | |
|---|---|---|---|---|
| 3 | 21/07/16 | PP | EDB UPDATE | DES: JWEN |
| 2 | 20/03/17 | PP | SEISMIC UPDATE | DATE: 15/11/09 |
| | | | | SCALE: NTS |

SHEET 3 OF 3

EDBSG3A0300PB