




4	21/07/16	PP	EDB UPDATE	DES: ASETH
3	20/03/17	PP	SEISMIC UPDATE	DATE: 16/03/03
NO.	DATE	BY	REVISION	SCALE: NTS

EDBSG3C0500KD

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

d000186ht

ENCLOSURE BOTTOM VIEW

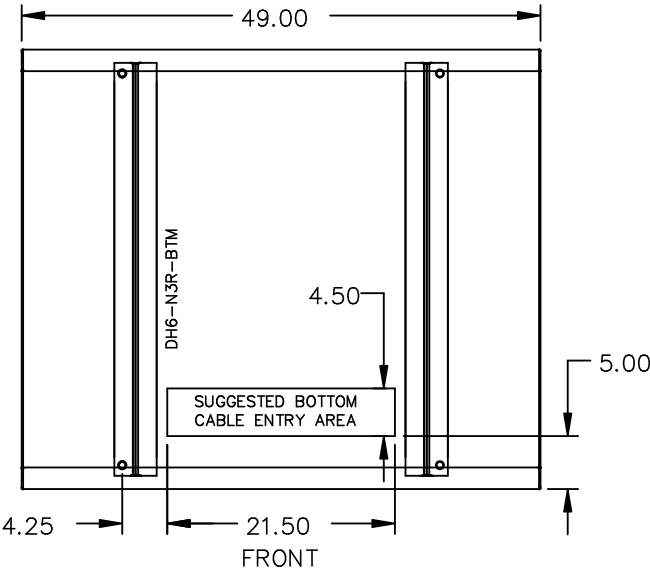

NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER ENCLOSURE BOTTOM VIEW					SHEET 3 OF 3
4	21/07/16	PP	EDB UPDATE	DES: ASETH	
3	20/03/17	PP	SEISMIC UPDATE	DATE: 16/03/03	
NO.	DATE	BY	REVISION	SCALE: NTS	

EDBSC3C0500KD