hammond POWER SOLUTIONS

Energy Efficient
General Purpose Distribution Transformer
Transformateur de Distribution
à usage général économe en énergie

Hyderabad, IN | Guelph, ONT | Compton, CA | Baraboo, WI | Monterrey, MX

Part No. SG3L0025HEOC

LR 3902


DRY TYPE TRANSFORMER 77U5 E112313 LISTED

8 03423 14108 0

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC.® 3VJ6

Cust. Ref. / Ref. du Client		Serial No. / No. de Serie	
Phase	1	HV/HT	416V 60.1A
Type	F	BIL	10 kV
Cooling / Refroidissement	ANN	Term / Bornes	H1 H2
kVA	25	LV/BT	120/240V 208/104A
Temp. Rise / Echauffement	150 °C	BIL	10 kV
Temp Class / Classe Temp	220 °C	Term / Bornes	X4 X2 X3 X1
Winding / Enroulement	CU	Energy Regulations	DOE 10 CFR PART 431:2016
Frequency / Frequence Hz	60	Reglements de Energetique	CEE ACT SOR/2018-201
Impedance % @ 170 °C	5.8		
Encl Type / Type De Coffrage	3R		
Weight / Poids lbs	220		

VOLTS	CURRENT / COURANT	% RATED VOLTAGE / % TENSION NOMINALE	CONNECTION EACH PHASE / CONNEXION PAR PHASE
437	57.2	105	1-2
426	58.6	102.5	2-3
416	60.1	100	3-4
406	61.6	97.5	4-5
395	63.3	95	5-6
120	208.3		X4&X2, X3&X1
240	104.2		X1, X4

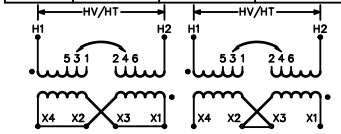

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

SEISMIC QUALIFICATIONS:
OSP-0136/IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=1 Ip=1.5

d000186hb

TITLE: 1PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

NO.	DATE	BY	REVISION
3	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE
2	21/07/16	PP	EDB UPDATE

SCALE: NTS | DATE: 18/08/09 | DES.: PPICASSI


SHEET 1 OF 3

EDB SG3L0025HEOC


3.0 httpd 2026/11/05 20:50

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW

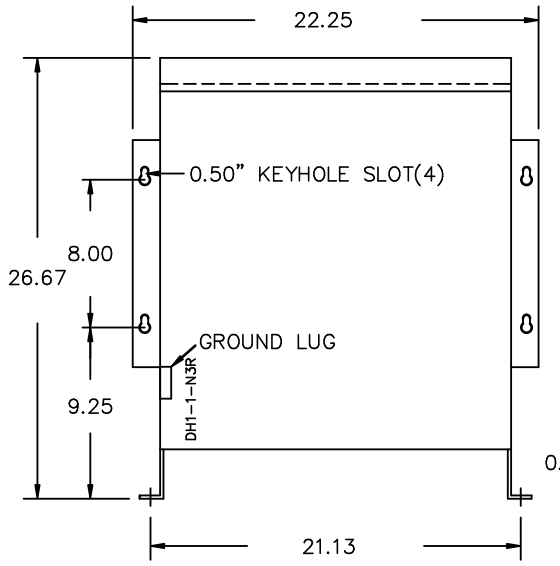

SIDE VIEW

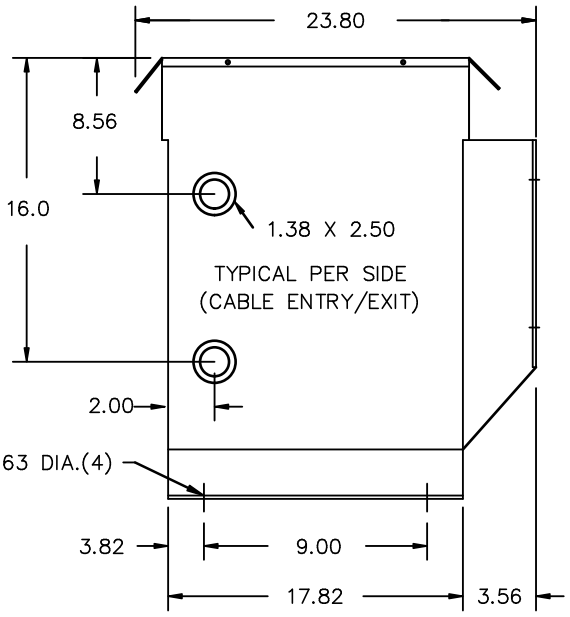

All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14–2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #2/0–14 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:
- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

3.0 httpd 2026/11/05 20:50

hammond POWER SOLUTIONS


TITLE: 1PH DISTRIBUTION TRANSFORMER

NO.	DATE	BY	REVISION
3	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE
2	21/07/16	PP	EDB UPDATE

DES: PPICASSI
DATE: 18/08/09
SCALE: NTS

EDBSG3L0025HE0C

ENCLOSURE BOTTOM VIEW

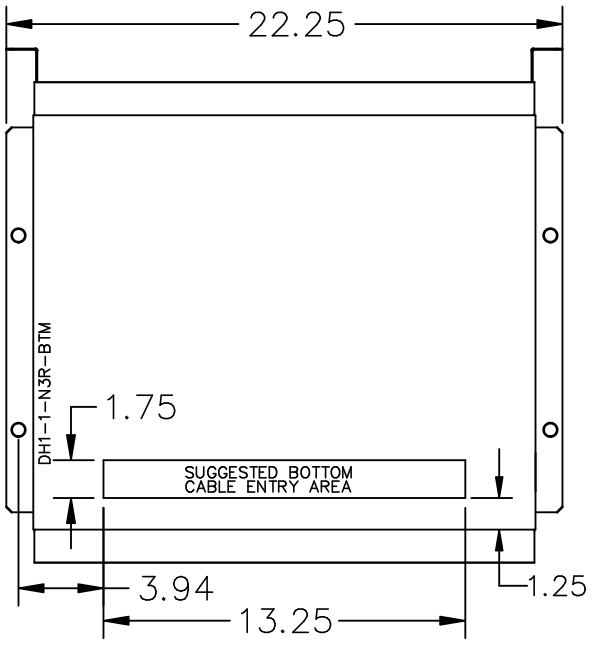

NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

hammond POWER SOLUTIONS

TITLE: 1PH DISTRIBUTION TRANSFORMER
ENCLOSURE BOTTOM VIEW

NO.	DATE	BY	REVISION	
3	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE	DES: PPICASSI
2	21/07/16	PP	EDB UPDATE	DATE: 18/08/09
				SCALE: NTS

SHEET 3 OF 3

EDBSG3L0025HE0C

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

3.0 httpd 2026/11/05 20:50