hammond POWER SOLUTIONS

HPS Sentinel™ G

Energy Efficient Distribution Transformer

Transformateur de Distribution à Bon Rendement Énergétique

Hyderabad, IN | Guelph, ONT / Compton, CA | Baraboo, WI / Monterrey, MX

Part No. SG3N0037LE0C

LR 3902

DRY TYPE TRANSFORMER 77U5 E112313 LISTED

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC.® 3VJ6

8 03423 14075 5

Cust. Ref. / Ref. du Client		Serial No. / No. de Serie	
Phase	1	HV/HT	240X480V 156.3/78.1A
Type	F	BIL	10 kV
Cooling / Refroidissement	ANN	Term / Bornes	H1 H3 H2 H4
kVA	37.5	LV/BT	120/240V 312.5/156A
Temp. Rise / Echauffement	150 °C	BIL	10 kV
Temp Class / Classe Temp	220 °C	Term / Bornes	X4 X2 X3 X1
Winding / Enroulement	CU	Energy Regulations	DOE 10 CFR PART 431:2016
Frequency / Frequence Hz	60	Reglements de Energetique	CEE ACT SOR/2018-201
Impedance % @ 170 °C	5.8		
Encl Type / Type De Coffrage	3R		
Weight / Poids lbs	280		

VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE
504	74.4	105	H1, H4
492	76.2	102.5	H1, H4
480	78.1	100	H1, H4
468	80.1	97.5	H1, H4
456	82.2	95	H1, H4
444	84.5	92.5	H1, H4
432	86.8	90	H1, H4
252	148.8	105	H1&H3, H2&H4
240	156.3	100	H1&H3, H2&H4
228	164.5	95	H1&H3, H2&H4
216	173.6	90	H1&H3, H2&H4

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

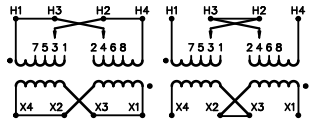

SEISMIC QUALIFICATIONS:
OSP-0136/IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=1 Ip=1.5

d000186hb

NO.	DATE	BY	REVISION
2	21/07/16	PP	EDB UPDATE
1	20/03/17	PP	SEISMIC UPDATE

TITLE: 1PH DISTRIBUTION TRANSFORMER NAMEPLATE INFORMATION

SCALE: NTS | DATE: 17/04/27 | DES.: PPICASSI

SHEET 1 OF 4

EDB SG3N0037LE0C

2.0 httpd 2026/06/24 21:40

PRIMARY VOLTS	CONNECTION LINES TO	INTER-CONNECT
504	H1,H4	1-H2,2-H3,H2-H3
492	H1,H4	3-H2,2-H3,H2-H3
480	H1,H4	3-H2,4-H3,H2-H3
468	H1,H4	5-H2,4-H3,H2-H3
456	H1,H4	5-H2,6-H3,H2-H3
444	H1,H4	7-H2,6-H3,H2-H3
432	H1,H4	7-H2,8-H3,H2-H3
252	H1&H3, H2&H4	1-H2,2-H3,H1-H3,H2-H4
240	H1&H3, H2&H4	3-H2,4-H3,H1-H3,H2-H4
228	H1&H3, H2&H4	5-H2,6-H3,H1-H3,H2-H4
216	H1&H3, H2&H4	7-H2,8-H3,H1-H3,H2-H4
SECONDARY VOLTS	CONNECTION LINES TO	INTER-CONNECT
240	X1,X4	X2-X3
120	X1&X3, X2&X4	X1-X3,X2-X4
120/240	X1, X2orX3, X4	X2-X3

hammond POWER SOLUTIONS

TITLE: 1PH DISTRIBUTION TRANSFORMER

NO.	DATE	BY	REVISION
2	21/07/16	PP	EDB UPDATE
1	20/03/17	PP	SEISMIC UPDATE

DES: PPICASSI
DATE: 17/04/27
SCALE: NTS

EDBSG3N0037LEOC

FRONT VIEW

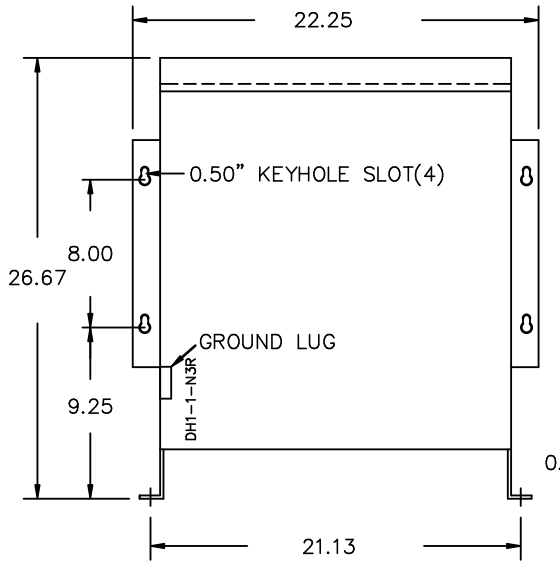

SIDE VIEW

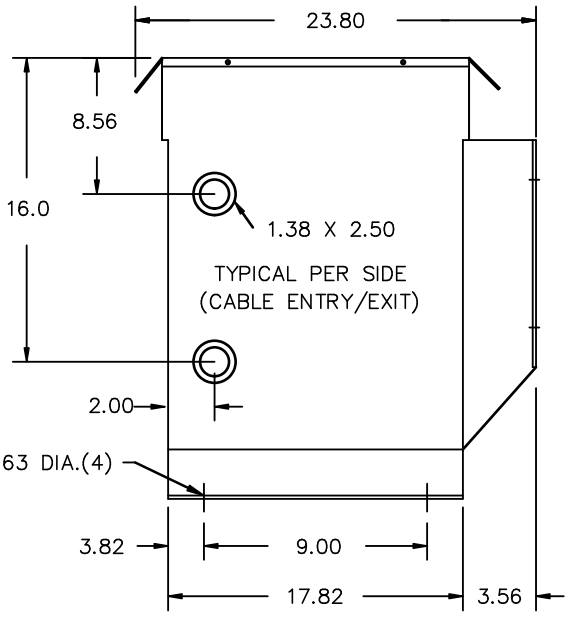

All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #2/0–14 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

LV1 TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR 250MCM–6 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:
- HV TERMINATED AT TOP FRONT
- LV1 TERMINATED AT BOTTOM FRONT

hammond POWER SOLUTIONS

TITLE: 1PH DISTRIBUTION TRANSFORMER

NO.	DATE	BY	REVISION
2	21/07/16	PP	EDB UPDATE
1	20/03/17	PP	SEISMIC UPDATE

DES: PPICASSI
DATE: 17/04/27
SCALE: NTS

SHEET 3 OF 4

EDBCSN0037LEOC

ENCLOSURE BOTTOM VIEW

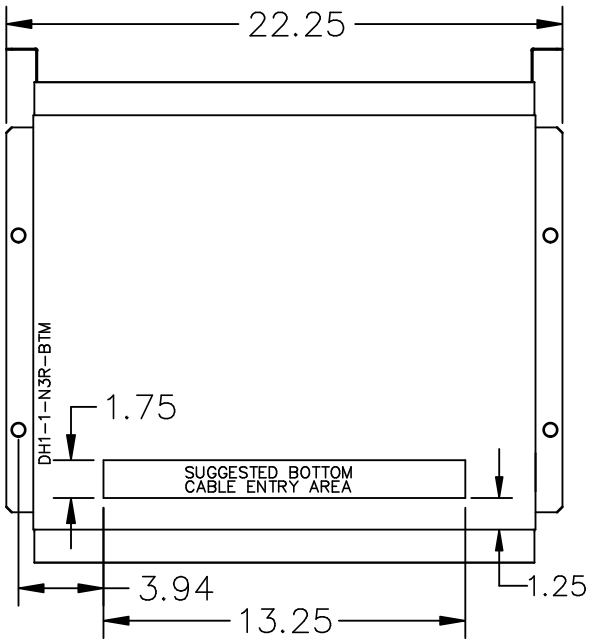

NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

hammond POWER SOLUTIONS

TITLE: 1PH DISTRIBUTION TRANSFORMER ENCLOSURE BOTTOM DRAWING

NO.	DATE	BY	REVISION	
2	21/07/16	PP	EDB UPDATE	DES: PPICASSI
1	20/03/17	PP	SEISMIC UPDATE	DATE: 17/04/27
				SCALE: NTS

SHEET 4 OF 4

EDBSSN003/LEOC