



TITLE: 1PH DISTRIBUTION TRANSFORMER  
NAMEPLATE INFORMATION


NO.	DATE	BY	REVISION
2	21/07/16	PP	EDB UPDATE
1	20/03/17	PP	SEISMIC UPDATE
			DES: PPICASSI
			DATE: 17/04/27
			SCALE: NTS

SHEET 1 OF 4

EDBSG3N0037LEOC

2.0 httpd 2026/04/25 11:19

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.



**POWER SOLUTIONS**  
Guelph, ONT  
Hyderabad, IN Compton, CA Monterrey, MX

**HPS Sentinel™ G**  
Energy Efficient Distribution Transformer  
Transformateur de Distribution à Bon Rendement Énergétique

Part No. **SG3N0037LEOC**


LR 3902  
DRY TYPE  
FORMER  
77US  
E112313

8 0342314075 5  
ALSO REFER TO CATALOGUE  
TV ENERGY STANDARDS CROUZE-ROUR  
BY UNDERWRITERS LABORATORIES INC. 0198

**LISTED**

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

VOLTS	CURRENT COURANT	% RATED % TENSION NOMINALE	CONNECTION EACH PHASE CONNECTION PAR PHASE
504	74.4	105	H1, H4
492	76.2	102.5	H1, H4
480	78.1	100	H1, H4
468	80.1	97.5	H1, H4
456	82.2	95	H1, H4
444	84.5	92.5	H1, H4
432	86.8	90	H1, H4
252	148.8	105	H1&H3, H2&H4
240	156.3	100	H1&H3, H2&H4
228	164.5	95	H1&H3, H2&H4
216	173.6	90	H1&H3, H2&H4

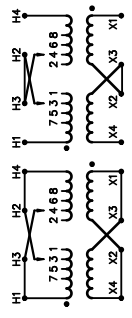

Cust. Ref.	Serial No.	240X480V	156.3/78.1A
Ref. du Client	No. de Serie	10 kV	
Phase	HV/HT	H1 H3 H2 H4	
Type	BIL	120/240V	312.5/156A
Cooling	Term Bornes	10 kV	
Refrédissement	LV/BT	X4 X2 X3 X1	
kVA	37.5	DOE 10 CFR PART 431:2016	
Temp. Rise	150 °C	CEE ACT SOR/2018-201	
Echauffement	220 °C		
Temp Class	CU		
Classe Temp	60		
Winding	Regulations		
Enroulement	Reglements		
Frequency	de		
Fréquence Hz	Energétique		
Impedance %			
@ 170 °C			
Encl. Type			
Type de Coffrage			
Weight			
Poids	280		

SEISMIC QUALIFICATIONS:  
OSP=0136/IBC 2018/ASCE 7-16  
SDS<=2.0g Z/h=1 Ip=1.5

PRIMARY VOLTS	CONNECTION LINES TO	INTER-CONNECT
504	H1,H4	1-H2,2-H3,H2-H3
492	H1,H4	3-H2,2-H3,H2-H3
480	H1,H4	3-H2,4-H3,H2-H3
468	H1,H4	5-H2,4-H3,H2-H3
456	H1,H4	5-H2,6-H3,H2-H3
444	H1,H4	7-H2,6-H3,H2-H3
432	H1,H4	7-H2,8-H3,H2-H3
252	H1&H3, H2&H4	1-H2,2-H3,H1-H3,H2-H4
240	H1&H3, H2&H4	3-H2,4-H3,H1-H3,H2-H4
228	H1&H3, H2&H4	5-H2,6-H3,H1-H3,H2-H4
216	H1&H3, H2&H4	7-H2,8-H3,H1-H3,H2-H4
SECONDARY VOLTS	CONNECTION LINES TO	INTER-CONNECT
240	X1,X4	X2-X3
120	X1&X3, X2&X4	X1-X3,X2-X4
120/240	X1, X2orX3, X4	X2-X3




TITLE: 1PH DISTRIBUTION TRANSFORMER

2	21/07/16	PP	EDB UPDATE	DES: PPICASSI
1	20/03/17	PP	SEISMIC UPDATE	DATE: 17/04/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 4

EDBSC3N0037E0C

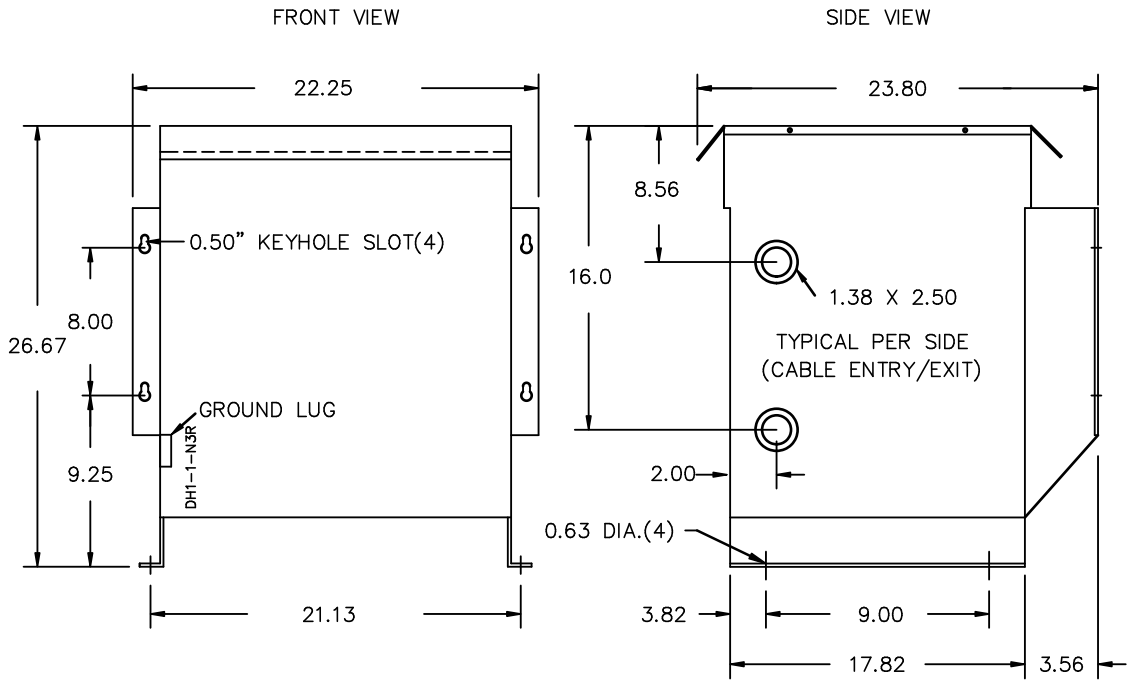

All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

LV1 TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR #2/0-14 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR 250MCM-6 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV1 TERMINATED AT BOTTOM FRONT




TITLE: 1PH DISTRIBUTION TRANSFORMER

2	21/07/16	PP	EDB UPDATE	DES: PPLICASSI
1	20/03/17	PP	SEISMIC UPDATE	DATE: 17/04/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 4

EDBSC3N0037LEOC

ENCLOSURE BOTTOM VIEW

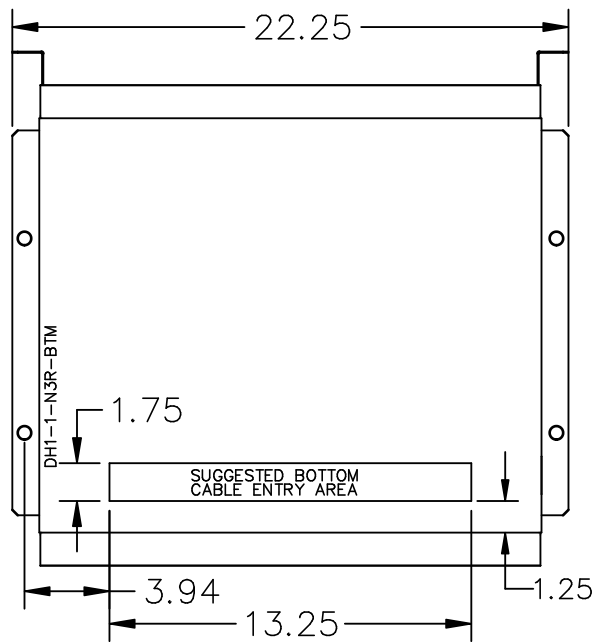

NOTE:  
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.  
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 1PH DISTRIBUTION TRANSFORMER  
 ENCLOSURE BOTTOM DRAWING

2	21/07/16	PP	EDB UPDATE	DES: PPICASSI
1	20/03/17	PP	SEISMIC UPDATE	DATE: 17/04/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 4 OF 4

EDBSC3N0037LEOC