



TITLE: 1PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION


3	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE	DES: PPICASSI
2	21/07/16	PP	EDB UPDATE	DATE: 17/04/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 4

EDBSG3N0050LEOC

3.0 httpd 2026/06/24 21:27

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.



POWER SOLUTIONS
Guelph, ONT
Hyderabad, IN Compton, CA Monterrey, MX

HPS Sentinel™ G
Energy Efficient Distribution Transformer
Transformateur de Distribution à Bon Rendement Énergétique

Part No. **SG3N0050LEOC**

DRY TYPE TRANSFORMER
77US E112313


LR 3902

0342314076

ALSO REFER TO CATALOGUE
TV ENERGY STANDARDS CRO215-18
BY UNDERWRITERS LABORATORIES INC. @ 3168

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

VOLTS	CURRENT COURANT	% RATED % TENSION NOMINALE	CONNECTION EACH PHASE CONNECTION PAR PHASE
504	99.2	105	H1, H4
492	101.6	102.5	H1, H4
480	104.2	100	H1, H4
468	106.8	97.5	H1, H4
456	109.6	95	H1, H4
444	113	92.5	H1, H4
432	116	90	H1, H4
252	198.4	105	H1&H3, H2&H4
240	208.3	100	H1&H3, H2&H4
228	219.3	95	H1&H3, H2&H4
216	231.5	90	H1&H3, H2&H4



SEISMIC QUALIFICATIONS:
OSP=0136/IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=1 Ip=1.5

Cust. Ref.	Serial No.	240X480V	208.3/104.2A
Ref. du Client	No. de Serie	10 kV	
Phase	HV/HT	H1 H3 H2 H4	
Type	BIL	LV/BT	120/240V 416.7/208A
Cooling	ANN	BIL	10 kV
Refréidissement		Term Bornes	X4 X2 X3 X1
kVA	50	CU	DOE 10 CFR PART 431:2016
Temp. Rise	150 °C	60	CEE ACT SOR/2018-201
Echauffement	220 °C	5.6	
Classe Temp		3R	
Winding		Weight	350
Enroulement		Poids	
Frequency			
Reglements			
Reglements			
de			
Energétique			
Impedance %			
@ 170 °C			
Encl. Type			
Type de Coffrage			
Weight			
Poids			

d000186hb

PRIMARY VOLTS	CONNECTION LINES TO	INTER-CONNECT
504	H1,H4	1-H2,2-H3,H2-H3
492	H1,H4	3-H2,2-H3,H2-H3
480	H1,H4	3-H2,4-H3,H2-H3
468	H1,H4	5-H2,4-H3,H2-H3
456	H1,H4	5-H2,6-H3,H2-H3
444	H1,H4	7-H2,6-H3,H2-H3
432	H1,H4	7-H2,8-H3,H2-H3
252	H1&H3, H2&H4	1-H2,2-H3,H1-H3,H2-H4
240	H1&H3, H2&H4	3-H2,4-H3,H1-H3,H2-H4
228	H1&H3, H2&H4	5-H2,6-H3,H1-H3,H2-H4
216	H1&H3, H2&H4	7-H2,8-H3,H1-H3,H2-H4
SECONDARY VOLTS	CONNECTION LINES TO	INTER-CONNECT
240	X1,X4	X2-X3
120	X1&X3, X2&X4	X1-X3,X2-X4
120/240	X1, X2orX3, X4	X2-X3




TITLE: 1PH DISTRIBUTION TRANSFORMER

3	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE	DES: PPLICASSI
2	21/07/16	PP	EDB UPDATE	DATE: 17/04/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 4

EDBSC3N0050LEDC

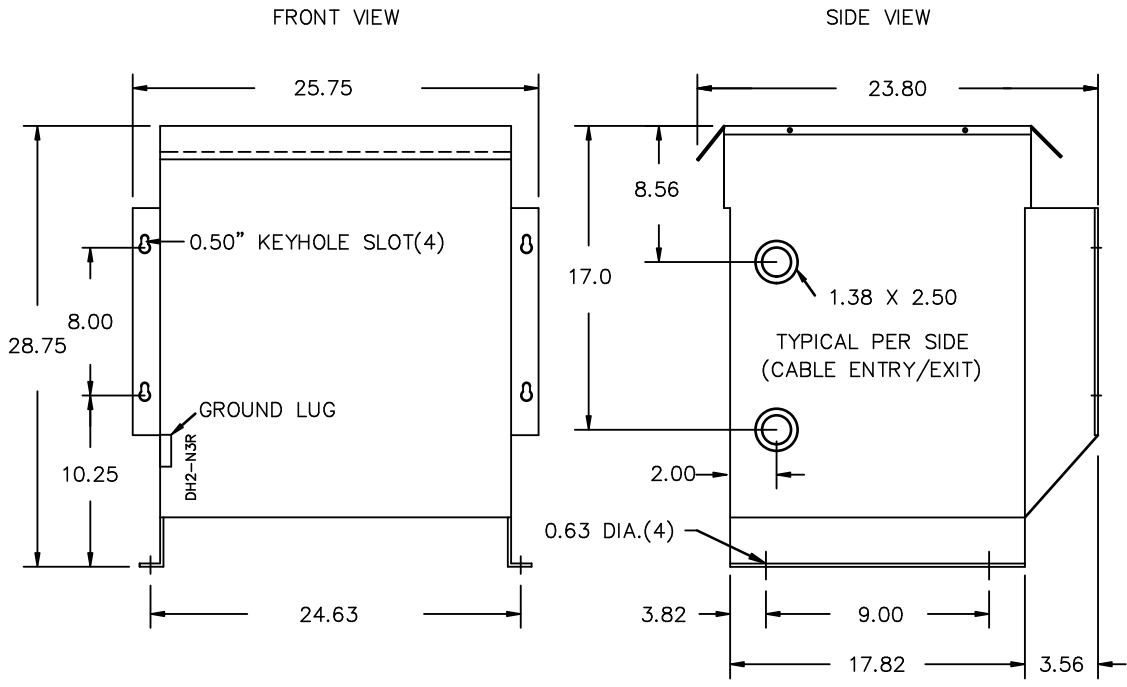

All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR 250MCM-6 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR 600MCM-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT



TITLE: 1PH DISTRIBUTION TRANSFORMER


3	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE	DES: PPLICASSI
2	21/07/16	PP	EDB UPDATE	DATE: 17/04/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 4

EDBSC3N0050LEOC

3.0 httpd 2026/06/24 21:27

ENCLOSURE BOTTOM VIEW

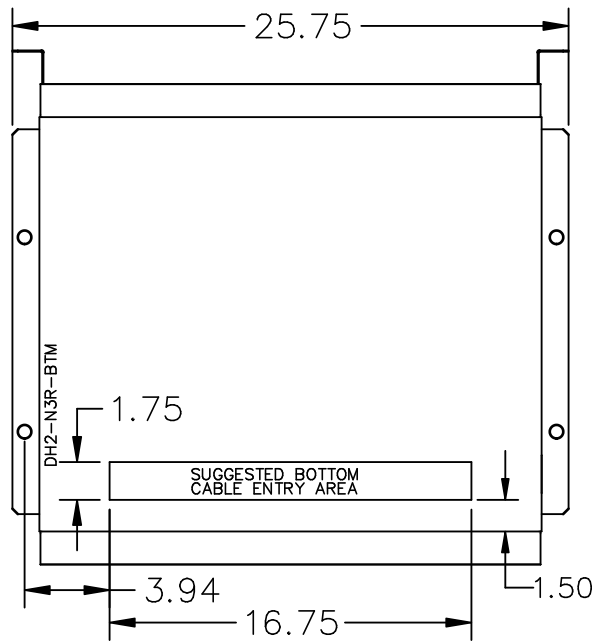

NOTE:
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 1PH DISTRIBUTION TRANSFORMER
 ENCLOSURE BOTTOM VIEW

3	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE	DES: PPICASSI
2	21/07/16	PP	EDB UPDATE	DATE: 17/04/27
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 4 OF 4

EDBSC3N0050LEOC