




TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

1	21/07/16	PP	EDB UPDATE	DES: CSHAH
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 3

EDB SH310015PB3S

1.0 httpd 2026/06/25 05:30



hammond
POWER SOLUTIONS

Guelph, ONT Compton, CA
Hyderabad, IN Compton, CA Monterrey, MX

HPS Sentinel™ H
DRY TYPE HARMONIC MITIGATING TRANSFORMER
TRANSFORMATEUR À SEC POUR MITIGATION D'HARMONIQUES


Part No. SH3T0015PB3S

Serial No. [] No. de Serie []
 Model [] HV/HT []
 Term Bornes []
 LV/BT []
 Term Bornes []
 Neutral []
 Energy Regulations []
 Reglements Energetique []
 Z₀ []
 Number of Secondaries []

Phase []
 Type [] HV/HT []
 Cooling Refroidissement []
 kVA []
 Temp. Rise Echauffement []
 Temp Class Classe Temp []
 Winding Enroulement []
 Frequency Fréquence Hz []
 Impedance % @ 170 °C []
 Encl Type Type De Coffrage []
 Weight Poids lbs []

VOLTS	CURRENT COURANT	% RATED VOLTAGE NOMINALE	CONNECTIONS CONNECTIONS PAR PHASE
630	13.7	105	1
615	14.1	102.5	2
600	14.4	100	3
585	14.8	97.5	4
570	15.2	95	5
555	15.6	92.5	6
540	16.0	90	7

DOE 10 CFR PART 431:2016
 CEE ACT SOR/2018-201
 0.95 MAX



ANGULAR DISPLACEMENT 0°


SEISMIC QUALIFICATIONS:
 GSP-0136/IBC 2018/ASCE 7-16
 SDS<=2.0g Z/h=1 Ip=1.5

LISTED


SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES ELECTROSTATIC SHIELD

d000190hb

FRONT VIEW

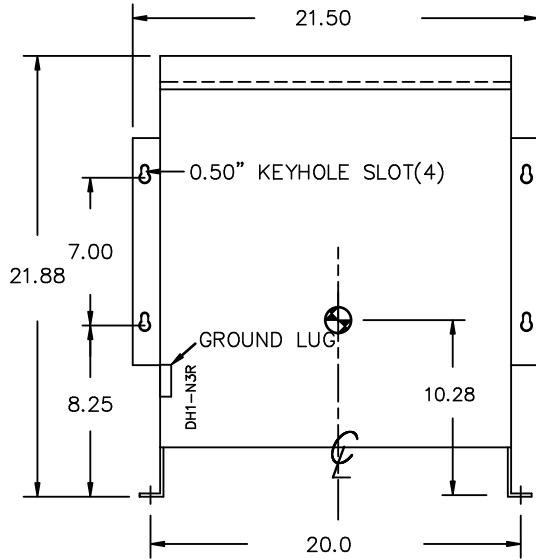

SIDE VIEW

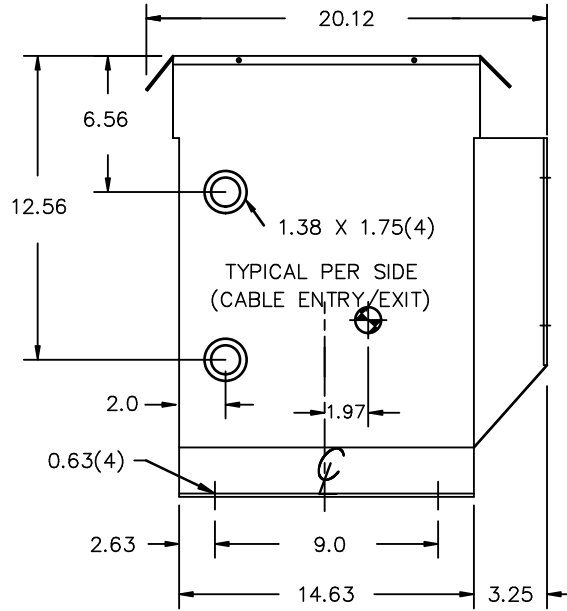

All Dimensions in inches

ENCLOSURE COLOR : ANSI-61 GREY PAINT OUTDOOR

HV TERMINAL DETAIL

LV TERMINAL DETAIL

X0 TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #2/0-14 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- X0 TERMINATED AT BOTTOM FRONT
- 200% RATED NEUTRAL PROVIDED



TITLE: 3PH DISTRIBUTION TRANSFORMER

1	21/07/16	PP	EDB UPDATE	DES: CSHAH
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBSH310015PB3S

1.0 httpd 2026/06/25 05:30

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

ENCLOSURE BOTTOM VIEW



NOTE:
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER
 ENCLOSURE BOTTOM VIEW

1	21/07/16	PP	EDB UPDATE	DES: CSHAH
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDBSH3T0015PB3S