hammond POWER SOLUTIONS

ENERGY EFFICIENT HARMONIC MITIGATING TRANSFORMER

TRANSFORMATEUR ÉCONOME EN ÉNERGIE RÉDUISANT LES HARMONIQUES

Hyderabad, IN | Guelph, ONT Compton, CA | Baraboo, WI Monterrey, MX

Part No. SH3T0030KB3S

® LR 3902


DRY TYPE TRANSFORMER 77U5 E112313 LISTED

8 03423 13480 8

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC.® 3VJ6

Cust. Ref. / Ref. du Client		Serial No. / No. de Serie	
Phase	3	Model	
Type	K	HV/HT	480V
Cooling / Refroidissement	ANN	Term / Bornes	H1 H2 H3
kVA	30	LV/BT	208Z/120V
Temp. Rise / Echauffement	150 °C	Term / Bornes	X1 X2 X3
Temp Class / Classe Temp	220 °C	Neutral	X0(200%)
Winding / Enroulement	AL	Energy Regulations	DOE 10 CFR PART 431:2016
Frequency / Frequence Hz	60	Reglements de Energetique	CEE ACT SOR/2018-201
Impedance % @ 170 °C	5.6	Z0	0.95 MAX
Encl Type / Type De Coffrage	3R	Number of Secondaries	
Weight / Poids lbs/kg	355/162		

VOLTS	CURRENT COURANT	%RATED VOLTAGE %TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE
504	34.4	105	1
492	35.2	102.5	2
480	36.1	100	3
468	37.0	97.5	4
456	38.0	95	5
444	39.0	92.5	6
432	40.1	90	7



SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES
ELECTROSTATIC SHIELD
SUITABLE FOR NON-SINUSOIDAL CURRENT LOAD WITH A K-FACTOR NOT TO EXCEED 13

SEISMIC QUALIFICATIONS:
AS FLOOR MOUNT ONLY
IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=0 Ip=1.5

d0001900b

NO.	DATE	BY	REVISION
3	25/10/15	LC	CHANGED NPL VER:
2	21/07/16	PP	EDB UPDATE

TITLE: 3PH DISTRIBUTION TRANSFORMER NAMEPLATE INFORMATION


SCALE: NTS | DATE: 19/05/08 | DES.: LCEN

SHEET 1 OF 3


EDB SH3T0030KB3S

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW

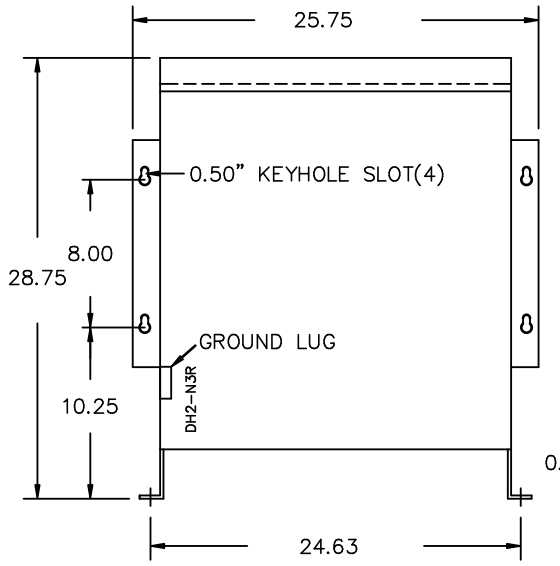

SIDE VIEW

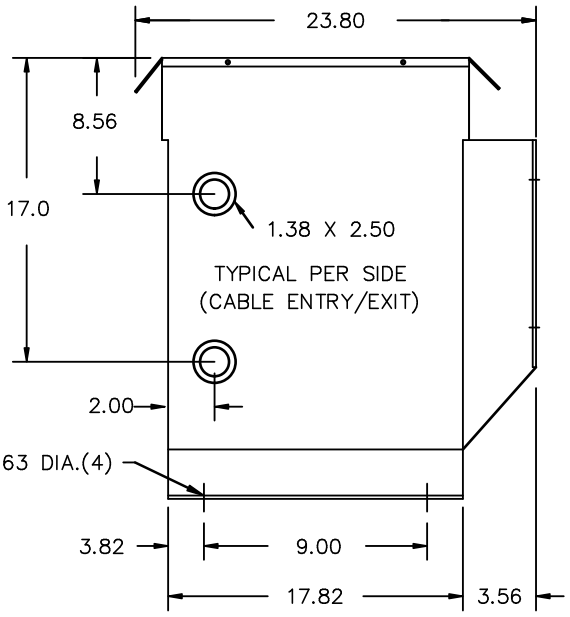

All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED SUITABLE FOR #14–2 CU/AL CONDUCTORS 1 CONDUCTOR PER PHASE

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED SUITABLE FOR #2/0–14 CU/AL CONDUCTORS 1 CONDUCTOR PER PHASE

X0 TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED SUITABLE FOR 350MCM–6 CU/AL CONDUCTORS 1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- X0 TERMINATED AT BOTTOM FRONT

200% RATED NEUTRAL PROVIDED

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

3.0 httpd 2026/11/05 19:48

hammond POWER SOLUTIONS


TITLE: 3PH DISTRIBUTION TRANSFORMER

NO.	DATE	BY	REVISION	
3	25/10/15	LC	CHANGED NPL VER:	DES: LCEN
2	21/07/16	PP	EDB UPDATE	DATE: 19/05/08
				SCALE: NTS

SHEET 2 OF 3

EDBSH3T0030KB3S

ENCLOSURE BOTTOM VIEW

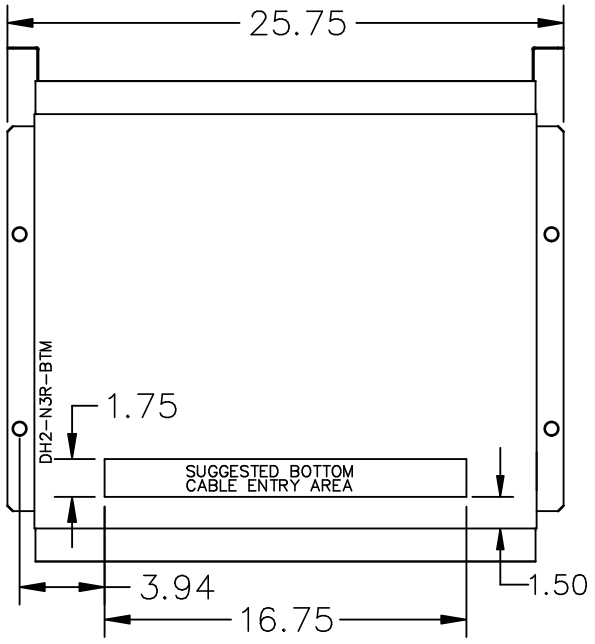

NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER ENCLOSURE BOTTOM VIEW

NO.	DATE	BY	REVISION	
3	25/10/15	LC	CHANGED NPL VER:	DES: LCEN
2	21/07/16	PP	EDB UPDATE	DATE: 19/05/08
				SCALE: NTS

SHEET 3 OF 3

EDBSH3T0030KB3S

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

3.0 httpd 2026/11/05 19:48