hammond POWER SOLUTIONS

ENERGY EFFICIENT HARMONIC MITIGATING TRANSFORMER

TRANSFORMATEUR ÉCONOME EN ÉNERGIE RÉDUISANT LES HARMONIQUES

Hyderabad, IN
Guelph, ONT
Compton, CA
Baraboo, WI
Monterrey, MX

Part No. SH3U0150PB3K

® LR 3902


DRY TYPE TRANSFORMER
77U5
E112313
LISTED

8 03423 13561 4

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC.® 3VJ6

Cust. Ref. / Ref. du Client		Serial No. / No. de Serie	
Phase	3	Model	
Type	K	HV/HT	600YV
Cooling / Refroidissement	ANN	Term / Bornes	H1 H2 H3
kVA	150	LV/BT	208Z/120V
Temp. Rise / Echauffement	150 °C	Term / Bornes	X1 X2 X3
Temp Class / Classe Temp	220 °C	Neutral	X0(200%)
Winding / Enroulement	CU	Energy Regulations	DOE 10 CFR PART 431:2016
Frequency / Frequence Hz	60	Reglements de Energetique	CEE ACT SOR/2018-201
Impedance % @ 170 °C	4.8	Z0	0.95 MAX
Encl Type / Type De Coffrage	3R	Number of Secondaries	
Weight / Poids lbs/kg	1320/599		

VOLTS	CURRENT / COURANT	%RATED VOLTAGE / %TENSION NOMINALE	CONNECTION EACH PHASE / CONNEXION PAR PHASE
630	137	105	1
615	141	102.5	2
600	144	100	3
585	148	97.5	4
570	152	95	5
555	156	92.5	6
540	160	90	7



SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 5 INCHES
ELECTROSTATIC SHIELD

SEISMIC QUALIFICATIONS:
AS FLOOR MOUNT ONLY
IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=1 Ip=1.5

d0001900b

TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

NO.	DATE	BY	REVISION
4	24/05/21	LC	CHANGED NPL VER:
3	21/07/16	PP	EDB UPDATE

SCALE: NTS
DATE: 18/01/17
DES.: LCEN


SHEET 1 OF 3

EDB SH3U0150PB3K


4.2 httpd 2026/11/06 02:26

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW

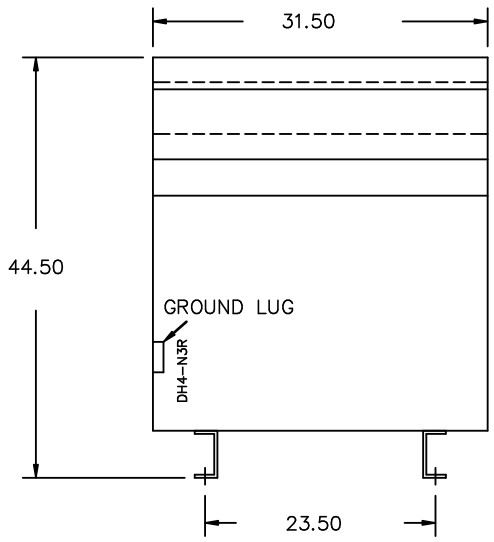

SIDE VIEW

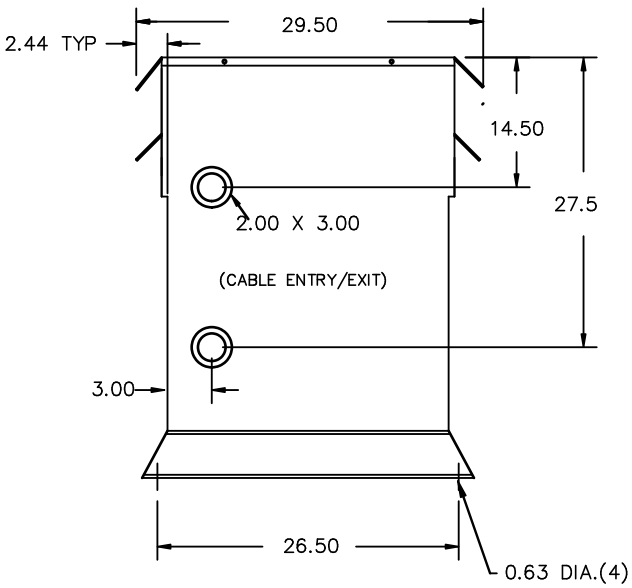

All Dimensions in inches

ENCLOSURE COLOR :ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED SUITABLE FOR 350MCM–6 CU/AL CONDUCTORS 1 CONDUCTOR PER PHASE	MECHANICAL TYPE LUGS INCLUDED SUITABLE FOR 600MCM–2 CU/AL CONDUCTORS 2 CONDUCTORS PER PHASE

CUSTOMER NOTES:

– HV TERMINATED AT TOP FRONT
– LV TERMINATED AT BOTTOM FRONT
200% RATED NEUTRAL

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

4.2 httpd 2026/11/06 02:26


hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER

NO.	DATE	BY	REVISION	SCALE: NTS
4	24/05/21	LC	CHANGED NPL VER:	DES: LCEN
3	21/07/16	PP	EDB UPDATE	DATE: 18/01/17

EDBSH3U0150PB3K

ENCLOSURE BOTTOM VIEW

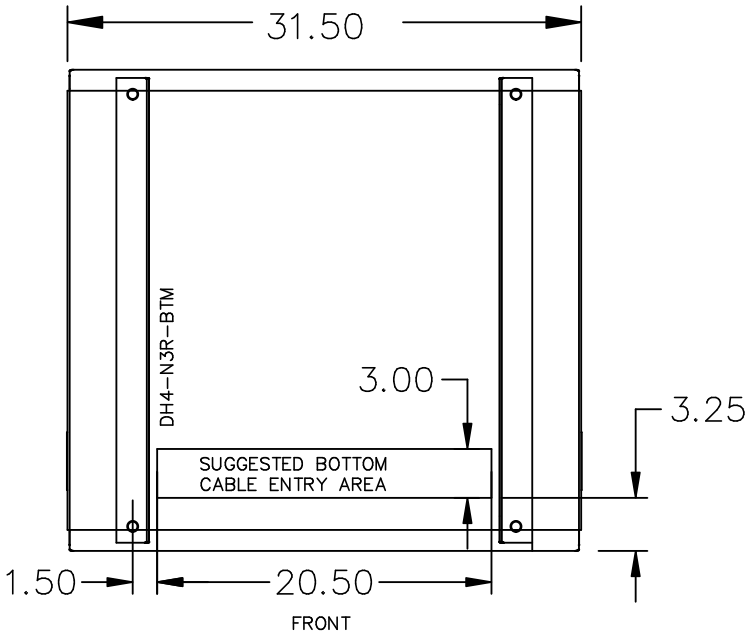

NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER
ENCLOSURE BOTTOM VIEW

NO.	DATE	BY	REVISION	
4	24/05/21	LC	CHANGED NPL VER:	DES: LCEN
3	21/07/16	PP	EDB UPDATE	DATE: 18/01/17
				SCALE: NTS

SHEET 3 OF 3

EDBSH3U0150PB3K

4.2 httpd 2026/11/06 02:26