



TITLE: 3PH DISTRIBUTION TRANSFORMER  
NAMEPLATE INFORMATION

NO.	DATE	BY	REVISION
4	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE
3	21/07/16	PP	EDB UPDATE

DES:	JWEN
DATE:	15/11/17
SCALE:	NTS

SHEET 1 OF 3

EDBSK3A0030KB3K




**POWER SOLUTIONS**  
Guelph, ONT Compton, CA  
Hyderabad, IN

**HPS Sentinel™ K**  
Energy Efficient Distribution Transformer  
Transformateur de Distribution à Bon Rendement Énergétique  
Baraboo, WI Monterrey, MX  
Part No. SK3A0030KB3K

Cust. Ref. [ ] Serial No. [ ]  
 Ref. du Client [ ] No. de Serie [ ]  
 Phase 3 HV/HT 480V  
 Type K BIL 10 kV  
 Cooling Refroidissement ANN Term Bornes H1 H2 H3  
 kVA 30 LV/BT 208Y/120V  
 Temp. Rise Echauffement 150 °C BIL 10 kV  
 Temp Class 220 °C Term Bornes X0 X1 X2 X3  
 Winding Enroulement CU Energy Regulations DOE 10 CFR PART 431:2016  
 Frequency Fréquence Hz 60 CEE ACT SOR/2018-201  
 Impedance % @ 170 °C 3.8 Suitable for non-sinusoidal current load with K-factor not to exceed 13  
 Encl Type Type De Coffrage 3R Convient à des courants non-sinusoidaux avec facteur K n'excédant pas 13  
 Weight Poids lbs 325

VOLTS	CURRENT COURANT	% RATED VOLTAGE % NOMINALE	CONNECTION CONNECTION PAR PHASE
504	34.4	105	1
492	35.2	102.5	2
480	36.1	100	3
468	37.0	97.5	4
456	38.0	95	5
444	39.0	92.5	6
432	40.1	90	7

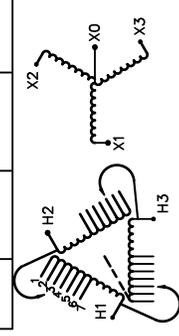

SEISMIC QUALIFICATIONS:  
 X3 FLOOR MOUNT ONLY  
 IBC 2018/ASCE 7-16  
 SDS<=2.0g Z/n=0 Ip=1.5

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES ELECTROSTATIC SHIELD

d000187hb



SP @ LR 3902  
 DRY TYPE TRANSFORMER



All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

H.V.1. TERMINAL DETAIL

L.V.1. TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR #14-2 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR #2/0-14 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV1 TERMINATED AT TOP FRONT
- LV1 TERMINATED AT BOTTOM FRONT

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.



TITLE: 3PH DISTRIBUTION TRANSFORMER

4	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE	DES: JWEN
3	21/07/16	PP	EDB UPDATE	DATE: 15/11/17
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBSK3A0030KB3K

4.0 httpd 2026/05/17 06:37

ENCLOSURE BOTTOM VIEW



NOTE:  
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.  
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER  
 ENCLOSURE BOTTOM VIEW

4	21/11/25	CS	NPL IMPEDANCE AND WEIGHT UPDATE	DES: JWEN
3	21/07/16	PP	EDB UPDATE	DATE: 15/11/17
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDBSK3A0030KB3K