




TITLE: 3PH DISTRIBUTION TRANSFORMER  
NAMEPLATE INFORMATION

|     |          |    |                |                |
|-----|----------|----|----------------|----------------|
| NO. | DATE     | BY | REVISION       | SCALE:         |
| 4   | 21/07/16 | PP | EDB UPDATE     | DES: JWEN      |
| 3   | 20/03/17 | PP | SEISMIC UPDATE | DATE: 16/09/08 |
|     |          |    |                | SCALE: NTS     |

SHEET 1 OF 3

EDBSK3A0045KK4K

4.0 httpd 2026/06/03 22:07



**POWER SOLUTIONS**  
Guelph, ONT  
Compton, CA

**HPS Sentinel™ K**  
Energy Efficient Distribution Transformer  
Transformateur de Distribution à Bon Rendement Énergétique  
Baraboo, WI  
Monterrey, MX

Hyderabad, IN    Part No. **SK3A0045KK4K**

Cust. Ref.

Ref. du Client

Phase

Type

Cooling Refroidissement

kVA

Temp. Rise Echauffement

Temp Class Classe Temp

Winding Enroulement

Frequency Fréquence Hz

Impedance % @ 170 °C

Encl Type Type De Coffrage

Weight Poids lbs

Serial No. No. de Serie

HV/HT

BIL

Term Bornes

LV/BT

BIL

Term Bornes


Energy Regulations Règlementations Énergétique

CEE ACT SOR/2018-201

Suitable for non-sinusoidal current load with K-factor not to exceed 4  
Convient à des courants non-sinusoidaux avec facteur K n'excédant pas 4

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES  
ÉLECTROSTATIC SHIELD

| VOLTS | CURRENT COURANT | % RATED VOLTAGE % NOMINALE | CONNECTION CONNECTION PAR PHASE |
|-------|-----------------|----------------------------|---------------------------------|
| 504   | 51.5            | 105                        | 1                               |
| 492   | 52.8            | 102.5                      | 2                               |
| 480   | 54.1            | 100                        | 3                               |
| 468   | 55.5            | 97.5                       | 4                               |
| 456   | 57.0            | 95                         | 5                               |
| 444   | 58.5            | 92.5                       | 6                               |
| 432   | 60.1            | 90                         | 7                               |

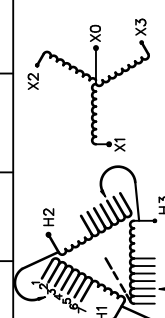

DRY TYPE TRANSFORMER E112313  
ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERMETERS LABORATORIES INC. © 316

LISTED

SEISMIC QUALIFICATIONS:  
GSP-0136/IBC, 2018/ASCE 7-16  
SDS<=2.0g Z/n=1 Ip=1.5

d000187hb

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.



All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

H.V.1. TERMINAL DETAIL

L.V.1. TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR #14-2 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR #14-2 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV1 TERMINATED AT TOP FRONT
- LV1 TERMINATED AT BOTTOM FRONT



TITLE: 3PH DISTRIBUTION TRANSFORMER

|     |          |    |                |                |
|-----|----------|----|----------------|----------------|
| 4   | 21/07/16 | PP | EDB UPDATE     | DES: JWEN      |
| 3   | 20/03/17 | PP | SEISMIC UPDATE | DATE: 16/09/08 |
| NO. | DATE     | BY | REVISION       | SCALE: NTS     |

SHEET 2 OF 3

EDBSK3A0045KK4K

4.0 httpd 2026/06/03 22:07 THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

ENCLOSURE BOTTOM VIEW



NOTE:  
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.  
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER  
 ENCLOSURE BOTTOM VIEW

|     |          |    |                |                |
|-----|----------|----|----------------|----------------|
| 4   | 21/07/16 | PP | EDB UPDATE     | DES: JWEN      |
| 3   | 20/03/17 | PP | SEISMIC UPDATE | DATE: 16/09/08 |
| NO. | DATE     | BY | REVISION       | SCALE: NTS     |

SHEET 3 OF 3

EDBSK3A0045KK4K