




TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

3	21/07/16	PP	EDB UPDATE	DES: JWEN
2	20/03/17	PP	SEISMIC UPDATE	DATE: 16/09/08
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 3


EDBSK3A0045PK9S

3.0 httpd 2026/04/07 00:30



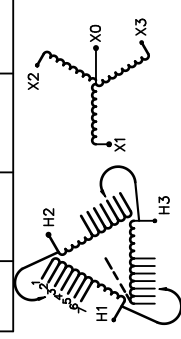
POWER SOLUTIONS
Guelph, ONT
Compton, CA

HPS Sentinel™ K
Energy Efficient Distribution Transformer
Transformateur de Distribution à Bon Rendement Énergétique



LR 3902
DRY TYPE TRANSFORMER E112313
ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD CROZ-18 BY UNDERWITERS LABORATORIES INC. 3106

Hyderabad, IN Monterrey, MX Part No. SK3A0045PK9S

Cust. Ref.	Serial No.	HV/HT	VOLTS	CURRENT COURANT	% RATED VOLTAGE NOMINALE	CONNECTION CONNECTION PAR PHASE
3	K	600V	630	41.2	105	1
Type	BIL	10 kV	615	42.2	102.5	2
Cooling Refroidissement	Term Bornes	H1 H2 H3	600	43.3	100	3
kVA	LV/BT	480Y/277V	585	44.4	97.5	4
Temp. Rise Echauffement	BIL	10 kV	570	45.6	95	5
Temp Class	Term Bornes	X0 X1 X2 X3	555	46.8	92.5	6
Winding Enroulement	Energy Regulations	DOE 10 CFR PART 431:2016	540	48.1	90	7
Frequency	Reglements Energetique	CEE ACT SOR/2018-201				
Impedance % @ 170°C	4.4	Suitable for non-sinusoidal current load with K-factor not to exceed 9 Convient à des courants non-sinusoidaux avec facteur K n'excédant pas 9				
Encl Type Type De Coffrage	3R	365	<p>SEISMIC QUALIFICATIONS: AS FLOOR MOUNT ONLY IBC 2018/ASCE 7-16 SDS<=2.0g Z/n=0 Ip=1.5</p>			
Weight Poids			<p>SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES ELECTROSTATIC SHIELD</p>			

d000187hb

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.



All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

H.V.1. TERMINAL DETAIL

L.V.1. TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR #14-2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV1 TERMINATED AT TOP FRONT
- LV1 TERMINATED AT BOTTOM FRONT



TITLE: 3PH DISTRIBUTION TRANSFORMER

3	21/07/16	PP	EDB UPDATE	DES: JWEN
2	20/03/17	PP	SEISMIC UPDATE	DATE: 16/09/08
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBSK3A0045PK9S

ENCLOSURE BOTTOM VIEW



NOTE:
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER
 ENCLOSURE BOTTOM VIEW

3	21/07/16	PP	EDB UPDATE	DES: JWEN
2	20/03/17	PP	SEISMIC UPDATE	DATE: 16/09/08
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDBSK3A0045PK9S