



TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

NO.	DATE	BY	REVISION	SCALE:
2	21/07/16	PP	EDB UPDATE	DES: GCALOTA
1	20/03/17	PP	SEISMIC UPDATE	DATE: 18/05/15
				NTS

SHEET 1 OF 3

EDBSK3A0500KK4K

2.1 httpd 2026/06/03 10:30

POWER SOLUTIONS

Hyderabad, IN Guelph, ONT Baraboo, WI Monterrey, MX

HPS Sentinel™ K

Energy Efficient Distribution Transformer

Transformateur de Distribution à Bon Rendement Énergétique

Part No. SK3A0500KK4K

LR 3902

DRY TYPE TRANSFORMER E112313

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD CRO22-18 BY UNDERWITERS LABORATORIES INC. © 316

LISTED

VOLTS	CURRENT COURANT	% RATED VOLTAGE % NOMINALE	CONNECTION CONNECTION PAR PHASE
504	573	105	1-2
492	587	102.5	2-3
480	601	100	3-4
468	617	97.5	4-5
456	633	95	5-6
444	650	92.5	6-7
432	668	90	7-8

Cust. Ref. Ref. du Client	Serial No. No. de Serie	HV/HT	480V	601A
Phase	3	BIL	10 kV	
Type	K	Term Bornes	H1 H2 H3	
Cooling Refroidissement	ANN	LV/BT	480Y/277V	601A
kVA	500	BIL	10 kV	
Temp. Rise Echauffement	150 °C	Term Bornes	X0 X1 X2 X3	
Temp Class Classe Temp	220 °C	Energy Regulations Réglements Energetique	DOE 10 CFR PART 431:2016	
Winding Enroulement	CU	CEE ACT SOR/2018-201		
Frequency Fréquence Hz	60	Suitable for non-sinusoidal current load with K-factor not to exceed 4		
Impedance % @ 170 °C	5.1	Convient à des courants non-sinusoidaux avec facteur K n'excédant pas		
Encl Type Type De Coffrage	3R			
Weight Poids	3100			

SEISMIC QUALIFICATIONS:
AS FLOOR MOUNT ONLY
IBC 2018/ASCE 7-16
SDS<=2.0g Z/n=0 Ip=1.5

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 12 INCHES ELECTROSTATIC SHIELD

d000187hb

FRONT VIEW



** - Recommended cable entry locations only
cutouts & gland plates not provided.

SIDE VIEW




All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY - OUTDOOR


HV TERMINAL DETAIL



LV TERMINAL DETAIL

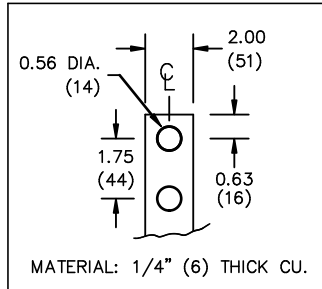

X0 TERMINAL DETAIL

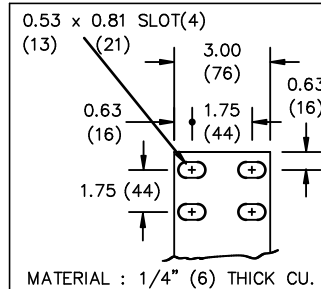

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- X0 TERMINATED AT BOTTOM FRONT
- 200% RATED NEUTRAL PROVIDED

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.



TITLE: 3PH DISTRIBUTION TRANSFORMER

2	21/07/16	PP	EDB UPDATE	DES: GCALOTA
1	20/03/17	PP	SEISMIC UPDATE	DATE: 18/05/15
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBSK3A0500KK4K

2.1 httpd 2026/06/03 10:30

ENCLOSURE BOTTOM VIEW



NOTE:
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER
 ENCLOSURE BOTTOM VIEW

2	21/07/16	PP	EDB UPDATE	DES: GCALOTA
1	20/03/17	PP	SEISMIC UPDATE	DATE: 18/05/15
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDBSK3A0500KK4K