



TITLE: 3PH DISTRIBUTION TRANSFORMER  
NAMEPLATE INFORMATION


1	20/03/17	PP	SEISMIC UPDATE	DES: RMOVVA
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 1 OF 3

EDB TE3A0040NNM

1.0 http://2026/06/12 20:32


THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.




**POWER SOLUTIONS**  
Guelph, ONT Compton, CA Baraboo, WI Monterrey, MX

**HPS Tribune™ E**  
Energy Efficient Drive Isolation Transformer  
Transformateur Pour Variateur de Vitesse à Efficacité Énergétique

LR 3902  
DRY TYPE  
TRANSFORMER  
77US  
E112313



LISTED




8 03423 174546 0

ALSO REFER TO THE INSTRUCTIONS  
TO ENERGY LABEL AND CROQ 15-18  
BY UNDERWRITERS LABORATORIES INC. © 2018

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES ELECTROSTATIC SHIELD

VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNECTION PAR PHASE
604	38.3	105	1
580	39.2	102.5	2
575	40.2	100	3
561	41.2	97.5	4
546	42.3	95	5

Cust. Ref. Ref. du Client	Serial No. No. de Serie	575V	40.2A
Phase	HV/HT	10 kV	
Type	BIL	H1 H2 H3	
Cooling Refroidissement	Term Bornes	575Y/332V	40.2A
kVA	LV/BT	10 kV	
Temp. Rise Échauffement	BIL	X0 X1 X2 X3	
Temp Class Classe Temp	Term Bornes	DOE EXEMPT	
Winding Enroulement	Energy Regulations	CEE ACT SOR/2018-201	
Frequency Fréquence Hz	Reglements de Énergétique		
Impedance % @ 170°C			
Encl. Type Type de Coffrage			
Weight Poids			380

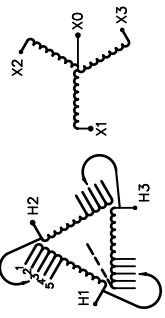

SEISMIC QUALIFICATIONS, AS FLOOR MOUNT ONLY  
QUALIFICATIONS SHOULD COME MINIMUM AS SET FORTH  
IBC 2018/ASCE 7-16  
SDS<=2.0g Z/h=0 Ip=1.5

d000194hb



All Dimensions in inches

ENCLOSURE COLOR : ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR #14-2 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

MECHANICAL TYPE LUGS INCLUDED  
SUITABLE FOR #14-2 CU/AL  
CONDUCTORS  
1 CONDUCTOR PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- C/W 1-"NC"- THERMOSTAT PER COIL CONNECTED TO T.B.



TITLE: 3PH DISTRIBUTION TRANSFORMER

1	20/03/17	PP	SEISMIC UPDATE	DES: RMOVVA
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBTE3A0040NM

1.0 httpd 2026/06/12 20:32

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

ENCLOSURE BOTTOM VIEW



NOTE:  
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.  
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER  
 ENCLOSURE BOTTOM VIEW

1	20/03/17	PP	SEISMIC UPDATE	DES: RMOVVA
				DATE: 19/10/30
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDBTE3A0040NM