hammond POWER SOLUTIONS

# HPS Tribune™ E

Energy Efficient Drive Isolation Transformer

Transformateur Pour Variateur de Vitesse à Efficacité Énergétique

Guelph, ONT
Compton, CA

Baraboo, WI
Monterrey, MX

Part No. TE3A0220NJ

LR 3902

DRY TYPE TRANSFORMER 77US E112313 LISTED


8 03423 14418 0

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD C802.2-18 BY UNDERWRITERS LABORATORIES INC.® 3VJ6

| | | | |
|---|---|---|---|
| Cust. Ref. / Ref. du Client | | Serial No. / No. de Serie | |
| Phase | 3 | HV/HT | 575V 221A |
| Type | K | BIL | 10 kV |
| Cooling / Refroidissement | ANN | Term / Bornes | H1 H2 H3 |
| kVA | 220 | LV/BT | 460Y/266V 276A |
| Temp. Rise / Echauffement | 150 °C | BIL | 10 kV |
| Temp Class / Classe Temp | 220 °C | Term / Bornes | X0 X1 X2 X3 |
| Winding / Enroulement | AL | Energy Regulations | DOE 10 CFR PART 431:2016 |
| Frequency / Frequence Hz | 60 | Reglements de Energetique | CEE ACT SOR/2018-201 |
| Impedance % @ 170 °C | 6.4 | | |
| Encl Type / Type De Coffrage | 3R | | |
| Weight / Poids lbs | 1450 | | |

| VOLTS | CURRENT / COURANT | % RATED VOLTAGE / % TENSION NOMINALE | CONNECTION EACH PHASE / CONNEXION PAR PHASE |
|---|---|---|---|
| 604 | 210 | 105 | 1 |
| 589 | 216 | 102.5 | 2 |
| 575 | 221 | 100 | 3 |
| 561 | 227 | 97.5 | 4 |
| 546 | 233 | 95 | 5 |

SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 5 INCHES EXCEPT WHEN WALL MOUNTED USING APPROVED WALL MOUNTING KIT
ELECTROSTATIC SHIELD

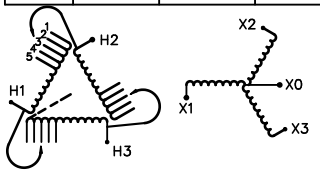


SEISMIC QUALIFICATIONS:
AS FLOOR MOUNT ONLY
IBC 2018/ASCE 7-16
SDS<=2.0g Z/h=0 Ip=1.5

d000194b

TITLE: 3PH DISTRIBUTION TRANSFORMER
NAMEPLATE INFORMATION

| NO. | DATE | BY | REVISION |
|---|---|---|---|
| 1 | 20/03/17 | PP | SEISMIC UPDATE |

SCALE: NTS
DATE: 19/05/27
DES.: PPICASSI


SHEET 1 OF 3

EDB TE3A0220NJ


1.0 httpd 2026/11/05 19:09

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

FRONT VIEW

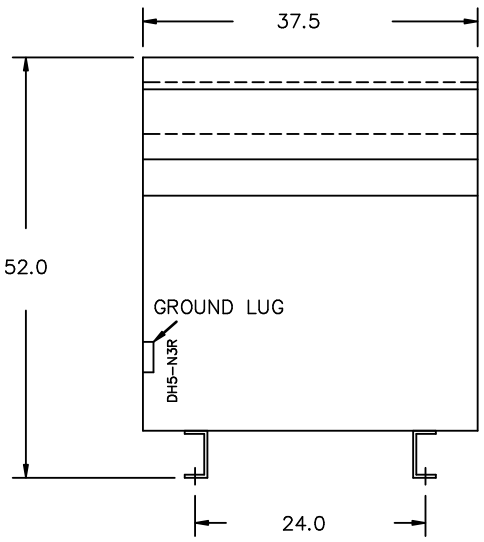


SIDE VIEW

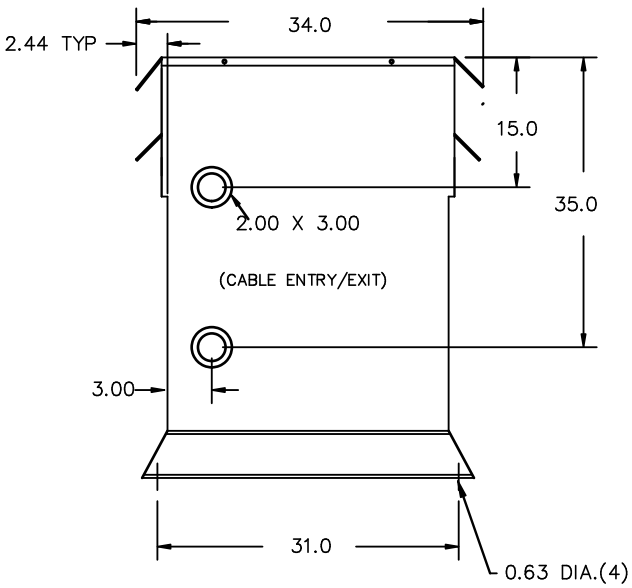


All Dimensions in inches

ENCLOSURE COLOR :ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR 600MCM–2 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

LV TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR 350MCM–6 CU/AL
CONDUCTORS
2 CONDUCTORS PER PHASE

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- C/W 1–"NC"– THERMOSTAT PER COIL CONNECTED TO T.B.

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

1.0 httpd 2026/11/05 19:09

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER


| NO. | DATE | BY | REVISION |
|---|---|---|---|
| 1 | 20/03/17 | PP | SEISMIC UPDATE |

DES: PPICASSI
DATE: 19/05/27
SCALE: NTS

SHEET 2 OF 3

EDB TE3A0220NJ

ENCLOSURE BOTTOM VIEW

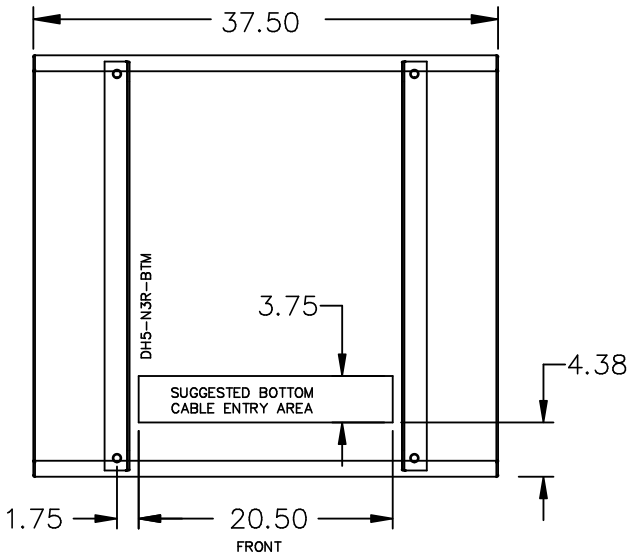


NOTE:
WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
SEE MANUAL FOR ADDITIONAL INFORMATION

THIS DRAWING CONTAINS STRICTLY CONFIDENTIAL INFORMATION BELONGING TO HAMMOND POWER SOLUTIONS AND MUST NOT BE DISTRIBUTED OUTSIDE AUTHORIZED PARTIES.

1.0 httpd 2026/11/05 19:09

hammond POWER SOLUTIONS

TITLE: 3PH DISTRIBUTION TRANSFORMER ENCLOSURE BOTTOM VIEW

| NO. | DATE | BY | REVISION |
|---|---|---|---|
| 1 | 20/03/17 | PP | SEISMIC UPDATE |

DES: PPICASSI
DATE: 19/05/27
SCALE: NTS

SHEET 3 OF 3

EDB TE3A0220NJ